



**Detcon Model Series
DM-600IS
Explosion Proof and Intrinsically Safe Toxic Gas Sensors**



Operator's Installation and Instruction Manual

◆ DETCON, Inc.
4055 Technology Forest Blvd. Suite 100,
The Woodlands, Texas 77381
Ph.281.367.4100 / Fax 281.298.2868
www.detcon.com

This page left intentionally blank

Table of Contents

1.0	Description.....	2
1.1	Sensor Technology.....	2
1.2	Universal Microprocessor Control Transmitter Circuit.....	3
1.3	Base Connector Board.....	3
1.4	Explosion Proof Enclosure.....	4
2.0	Principle of Operation.....	5
3.0	Application.....	5
3.1	Sensor Placement/Mounting.....	5
3.2	Interference Data.....	5
3.3	Interference Gas List.....	6
3.4	Interference Gas Table (page 1 of 5).....	7
4.0	Specifications.....	12
5.0	Installation.....	13
5.1	Field Wiring Table (4-20 mA output).....	13
5.2	Sensor Location.....	14
5.3	Local Electrical Codes.....	15
5.4	Installation Procedure.....	16
5.5	Remote Mounting Applications.....	20
6.0	Startup.....	21
6.1	Initial Operational Tests.....	21
7.0	Operating Software & Magnetic Interface.....	22
7.1	Normal Operation.....	22
7.2	Calibration Mode.....	22
7.2.1	<i>Zero Adjustment</i>	22
7.2.2	<i>Span Adjustment</i>	22
7.3	Program Mode.....	22
7.3.1	<i>Program Status</i>	22
7.3.2	<i>Alarm 1 Level Adjustment</i>	23
7.3.3	<i>Alarm 2 Level Adjustment</i>	23
7.3.4	<i>Calibration Level Adjustment</i>	23
7.4	Programming Magnet Operating Instructions.....	23
8.0	Software Flow Chart.....	25
9.0	Calibration.....	26
9.1	Calibration Procedure – Zero.....	26
9.2	Calibration Procedure – Span.....	26
9.3	Additional Notes.....	27
9.4	Calibration Frequency.....	28
10.0	Status of Programming, Version, Alarms, Calibration Level, RS-485, and Sensor Life.....	28
11.0	Programming Alarms.....	29
11.1	Alarm Levels.....	29
11.2	Alarm Reset.....	29
11.3	Other Alarm Functions.....	29
12.0	Program Features.....	30

13.0 Universal Transmitter Feature (Re-Initialization)	31
14.0 RS-485 Protocol	32
15.0 Display Contrast Adjust	34
16.0 Trouble Shooting	34
17.0 Spare Parts List	36
18.0 Warranty	38
19.0 Service Policy	38
20.0 Revision History	38

Table of Figures

Figure 1 Construction of Electrochemical Sensor.....	3
Figure 2 Universal Microprocessor Control Transmitter circuit.....	3
Figure 3 Base connector board.....	4
Figure 4 Explosion-Proof Enclosure.....	4
Figure 5 Functional Block Diagram.....	5
Figure 6 Typical Installation	15
Figure 7 Typical Outline and Mounting Dimensions.....	16
Figure 8 Sensor wiring	17
Figure 9 Alarm Programming Jumpers	17
Figure 10 RS-485 ID set Dip Switch.....	18
Figure 11 Remote wiring diagram.....	20
Figure 12 Programming magnet.....	23
Figure 13 Programming Switch locations	24
Figure 14 Software Flow Chart.....	25
Figure 15 Spare parts diagram.....	36

List of Tables

Table 1 Model #, Gas Name and Symbol.....	1
Table 2 Sensor cell specifications	12
Table 3 Field wiring Table	13
Table 4 Over-current Protection per AWG	13
Table 5 RS-485 Rotary Dip Switch Settings.....	19
Table 6 IS Sensor Head / Plug-in Replacement Sensor Cell.....	37

This manual covers the following Models...

Table 1 Model #, Gas Name and Symbol

Model #	Gas Name	Symbol
DM-600-C2H3O	Acetaldehyde	C2H3O
DM-600-C2H2	Acetylene	C2H2
DM-600-C3H3N	Acrylonitrile	C3H3N
DM-600-NH3 (-20°C)	Ammonia	NH3
DM-601-NH3 (-40°C)	Ammonia	NH3
DM-602-NH3	Ammonia (continuous exposure)	NH3
DM-600-AsH3	Arsine	AsH3
DM-600-Br2	Bromine	Br2
DM-600-C4H6	Butadiene	C4H6
DM-600-CS2	Carbon Disulfide	CS2
DM-600-CO	Carbon Monoxide	CO
DM-600-COS	Carbonyl Sulfide	COS
DM-600-CL2	Chlorine	CL2
DM-600-CLO2	Chlorine Dioxide (>50 ppm range)	CLO2
DM-601-CLO2	Chlorine Dioxide (≤50 ppm range)	CLO2
DM-600-B2H6	Diborane	B2H6
DM-600-C2H6S	Dimethyl Sulfide	C2H6S
DM-600-C3H5OCL	Epichlorohydrin	C3H5OCL
DM-600-C2H5OH	Ethanol	C2H5OH
DM-600-C2H5SH	Ethyl Mercaptan	C2H5SH
DM-600-C2H4	Ethylene	C2H4
DM-600-C2H4O	Ethylene Oxide	C2H4O
DM-600-F2	Fluorine	F2
DM-600-CH2O	Formaldehyde	CH2O
DM-600-GeH4	Germane	GeH4
DM-600-N2H4	Hydrazine	N2H4
DM-600-H2	Hydrogen (ppm range)	H2
DM-601-H2	Hydrogen (% LEL range)	H2
DM-600-HBr	Hydrogen Bromide	HBr
DM-600-HCL	Hydrogen Chloride	HCL
DM-600-HCN	Hydrogen Cyanide	HCN
DM-600-HF	Hydrogen Fluoride	HF
DM-600-H2S	Hydrogen Sulfide	H2S
DM-600-CH3OH	Methanol	CH3OH
DM-600-CH3SH	Methyl Mercaptan	CH3SH
DM-600-NO	Nitric Oxide	NO
DM-600-NO2	Nitrogen Dioxide	NO2
DM-600-O3	Ozone	O3
DM-600-COCL2	Phosgene	COCL2
DM-600-PH3	Phosphine	PH3
DM-600-SiH4	Silane	SiH4
DM-600-SO2	Sulfur Dioxide	SO2
DM-600-C4H8S	Tetrahydrothiophene	C4H8S
DM-600-C4H4S	Thiophane	C4H4S
DM-600-C6H5CH3	Toluene	C6H5CH3
DM-600-C4H6O2	Vinyl Acetate	C4H6O2
DM-600-C2H3CL	Vinyl Chloride	C2H3CL

1.0 Description

Detcon MicroSafe™ Model DM600IS, toxic sensors are nonintrusive “Smart” sensors designed to detect and monitor for toxic gas in the ppm range. One of the primary features of the sensor is its method of automatic calibration which guides the user through each step via instructions displayed on the backlit LCD. The sensor features LED indicators for 2 ALARMS, FAULT and CAL status, field adjustable, fully programmable alarms and provides relays for two alarms plus fault as standard. The sensor comes with two different outputs: analog 4-20 mA, and serial RS-485. These outputs allow for greater flexibility in system integration and installation. The microprocessor supervised electronics are packaged as a universal plugin transmitter module that mates to a standard connector board. Both are housed in an explosion proof conduit that includes a glass lens. A 16 character alpha/numeric indicator is used to display sensor readings as well as the sensor’s menu driven features via a handheld programming magnet.

Typical ranges of detection are 0-10ppm, 0-25ppm, 0-50ppm, and 0-100ppm. Other ranges are available and all ranges are covered by this manual. To determine sensor model number, reference the label located on the enclosure cover.



To determine gas type and range, reference labeling on the intrinsically-safe sensor head.

1.1 Sensor Technology

The sensors are electrolytic chemical cells. Each cell consists of three electrodes embedded in an electrolyte solution all housed beneath a diffusion membrane. Sensitivity to specific target gases is achieved by varying composition of any combination of the sensor components. Good specificity is achieved in each sensor type. The cells are diffusion limited via small capillary barriers resulting in long service life of up to 3 or more years. The fuel cell is packaged as field replaceable plug-in sensor via gold plated pins. Pre-amplifier and intrinsically safe barrier circuits are epoxy potted in the stainless steel housing and include the mating sockets for the sensor.

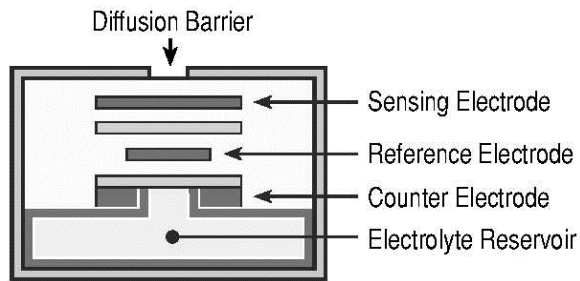


Figure 1 Construction of Electrochemical Sensor

1.2 Universal Microprocessor Control Transmitter Circuit

The control circuit is microprocessor based and is packaged as a universal plug-in field replaceable module, facilitating easy replacement and minimum down time. The universality includes the ability to set it for any range concentration and for any gas type. These gas and range settings must be consistent with the IS Sensor Head it is mated with. Circuit functions include a basic sensor pre-amplifier, on-board power supplies, microprocessor, back lit alpha numeric display, fault, alarm, and calibration status LED indicators, magnetic programming switches, an RS-485 communication port, and a linear 4-20 mA DC output.

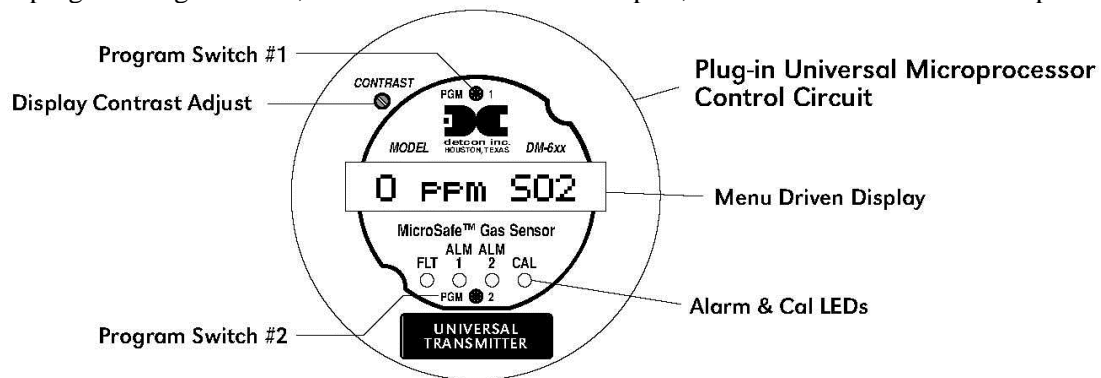


Figure 2 Universal Microprocessor Control Transmitter circuit

1.3 Base Connector Board

The base connector board is mounted in the explosion proof enclosure and includes: the mating connector for the control circuit, reverse input and secondary transient suppression, input filter, alarm relays, lugless terminals for all field wiring, and a terminal strip for storing unused programming jumper tabs. The alarm relays are contact rated 5 amps @ 125 VAC, 5 amps @ 30 VDC and coil rated at 24 VDC. Gold plated program jumpers are used to select either the normally open or normally closed relay contacts.

NOTE: The yellow wire should not be connected and should be cut off!

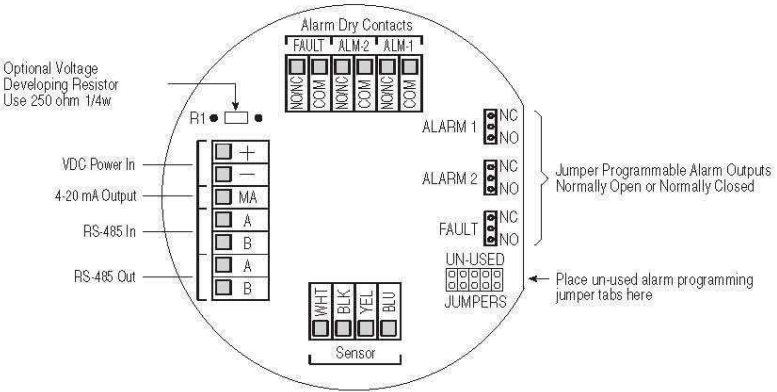


Figure 3 Base connector board

1.4 Explosion Proof Enclosure

The transmitter electronics are packaged in a cast metal explosion proof enclosure. The enclosure is fitted with a threaded cover that has a glass lens window. Magnetic program switches located behind the transmitter module face plate are activated through the lens window via a hand-held magnetic programming tool allowing non-intrusive operator interface with the sensor. Calibration can be accomplished without removing the cover or declassifying the area. Electrical classification is Class 1; Groups B, C, D; Division 1 (explosion proof). The sensor housing section employs an Intrinsically Safe Barrier circuit which allows for the safe usage of plastic housing materials in the lower section. This design benefit avoids the requirement for stainless steel flame arrestors which reduce the sensitivity and response time to “active” gas species such as NH3, CL2, CLO2, and HCL...etc.

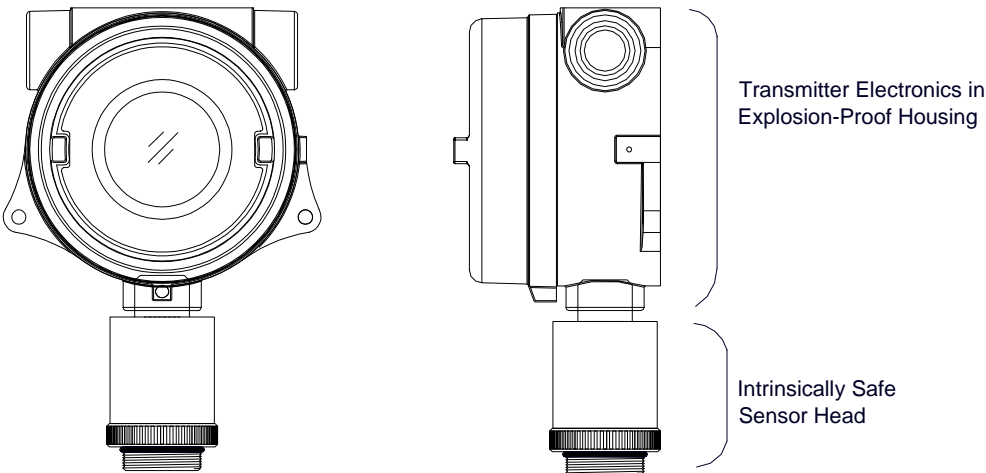


Figure 4 Explosion-Proof Enclosure

2.0 Principle of Operation

Method of detection is by an electrochemical reaction at the surface of an electrode called the sensing electrode. Air and gas diffuse through the capillary diffusion barrier. The controlling circuit maintains a small external operating voltage between the sensing and counter electrodes of the proper bias and magnitude so that no current flows to or from the reference electrode while its potential is maintained at the correct fixed voltage — usually ground. The electrochemical reaction creates a change in current flow from the counter electrode to the sensing electrode. This change in current is proportional to the gas concentration and is reversible. The quick response of the sensor results in continuous monitoring of ambient air conditions. The Intrinsically Safe Sensor Housing design allows direct contact of the target gas to the electrochemical sensor, thus maximizing response time, detectability and repeatability.

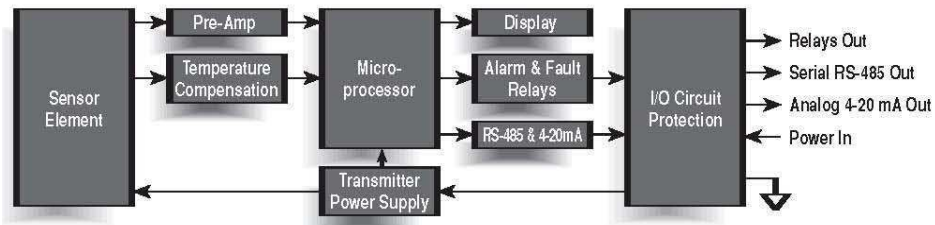


Figure 5 Functional Block Diagram

3.0 Application

3.1 Sensor Placement/Mounting

Sensor location should be reviewed by facility engineering and safety personnel. Area leak sources and perimeter mounting are typically used to determine number and location of sensors. The sensors are generally located 2 - 4 feet above grade.

3.2 Interference Data

Detcon Model DM-600IS series electrochemical sensors are subject to interference from other gases. This interaction is shown in the table in section 3.4 as the relation between the amount of the interfering gas applied to the sensor, and the corresponding reading that will occur. All measurements are in ppm unless otherwise noted.

The table is laid out with the Model Number of each sensor in a column on the left side of the page. The interfering gases are listed in a row across the top of the page. Each page lists all Model Numbers but 5 pages are necessary to list all interfering gases, thus each page is a repeat of the full line of Detcon sensors. Be sure to reference each page to ascertain the full listing of interfering gases for a particular sensor.

As an example, the first listing shows that the Model DM-600IS-C2H30 acetaldehyde sensor will have an interference reading of 340 ppm if 40 ppm of C₂H₂ (Acetylene) is applied.

NOTE: Interference factors may differ from sensor to sensor and with life time. It is not advisable to calibrate with interference gases. They should be used as a guide only

3.3 Interference Gas List

Gas Name	Symbol	Gas Name	Symbol
Acetaldehyde	C ₂ H ₃ O	Hydrocarbons	C-H's
Acetylene	C ₂ H ₂	Hydrocarbons (unsaturated)	C-H's (u)
Acrylonitrile	C ₃ H ₃ N	Hydrogen	H ₂
Alcohols	Alcohols	Hydrogen Bromide	HBr
Amines	Amines	Hydrogen Chloride	HCL
Ammonia	NH ₃	Hydrogen Cyanide	HCN
Arsenic Trifluoride	AsF ₃	Hydrogen Fluoride	HF
Arsenic Pentafluoride	AsF ₅	Hydrogen Selenide	HSe
Arsine	AsH ₃	Hydrogen Sulfide	H ₂ S
Boron Trifluoride	BF ₃	Iodine	I ₂
Bromine	Br ₂	Isopropanol	C ₃ H ₈ O
Butadiene	C ₄ H ₆	Methane	CH ₄
Buten-1	Buten-1	Methanol	CH ₃ OH
Carbon Dioxide	CO ₂	Methyl-Ethyl-Ketone	C ₄ H ₈ O
Carbon Disulfide	CS ₂	Methyl Mercaptan	CH ₃ SH
Carbon Oxide Sulfide	COS	Nitric Oxide	NO
Carbon Monoxide	CO	Nitrogen	N ₂
Carbonyl Sulfide	COS	Nitrogen Dioxide	NO ₂
Chlorine	CL ₂	Ozone	O ₃
Chlorine Dioxide	CLO ₂	Phosgene	COCL ₂
Chlorine Trifluoride	CLF ₃	Phosphine	PH ₃
Diborane	B ₂ H ₆	Phosphorous Trifluoride	PF ₃
Dimethyl Sulfide	C ₂ H ₆ S	Silane	SiH ₄
Disilane	Si ₂ H ₆	Silicon	Si
Epichlorohydrin	C ₃ H ₅ OCL	Silicon Tetra Fluoride	SiF ₄
Ethanol	C ₂ H ₅ OH	Sulfur Dioxide	SO ₂
Ethyl Mercaptan	C ₂ H ₅ SH	Tetrahydrothiophene	C ₄ H ₈ S
Ethylene	C ₂ H ₄	Thiophane	C ₄ H ₄ S
Ethylene Oxide	C ₂ H ₄ O	Toluene	C ₆ H ₅ CH ₃
Fluorine	F ₂	Tungsten Hexafluoride	WF ₆
Formaldehyde	CH ₂ O	Vinyl Acetate	C ₄ H ₆ O ₂
Germane	GeH ₄	Vinyl Chloride	C ₂ H ₃ CL
Hydrazine	N ₂ H ₄		

3.4 Interference Gas Table (page 1 of 5)

NOTE: Reference the listing in Table 1 to match model number with gas name. Reference the listing in section 3.3 to match the interfering gas symbol with the gas name.

Model Number	C2H3O	C2H2	C3H3	Alcohol	Amine	NH3	AsF3	AsF5	AsH3	BF3	Br2	C4H6	Buten-
DM-600IS-C2H3O	n/a	40=340	40=75	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	40=170	n/d
DM-600IS-C2H2	340=4	n/a	340=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	340=17	n/d
DM-600IS-C3H3N	75=40	75=340	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	75=170	n/d
DM-600IS-NH3	(-n/d	n/d	n/d	1000=0	yes n/d	n/a	n/d	n/d	1=0	n/d	n/d	n/d	n/d
DM-501IS-NH3	(-n/d	n/d	n/d	n/d	yes n/d	n/d	n/d	n/d	1=0	n/d	n/d	n/d	n/d
DM-502IS-NH3 (CE)	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-AsH3	n/d	n/d	n/d	n/d	n/d	100=0.01	n/d	n/a	n/d	n/d	n/d	n/d	n/d
DM-600IS-Br2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/a	n/d	n/d
DM-600IS-C4H6	170=4	170=34	170=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/a	n/d
DM-600IS-CS2	140=4	140=34	140=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	140=17	n/d
DM-600IS-CO	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-COS	135=4	135=34	135=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	135=17	n/d
DM-600IS-CL2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	1=0.55	n/d	n/d
DM-600IS-CLO2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	1=0.18	n/d	n/d
DM-501IS-CLO2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-B2H6	n/d	n/d	n/d	n/d	n/d	100=0.01	n/d	n/d	0.15=0.	n/d	n/d	n/d	n/d
DM-600IS-C2H6S	150=4	150=34	150=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	150=17	n/d
DM-600IS-C3H5OCL	50=40	50=340	50=75	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	50=170	n/d
DM-600IS-C2H5OH	180=4	180=34	180=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	180=17	n/d
DM-600IS-C2H5SH	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H4	220=4	220=34	220=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	220=17	n/d
DM-600IS-C2H4O	275=4	275=34	275=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	275=17	n/d
DM-600IS-F2	n/d	n/d	n/d	1000=0	n/d	n/d	n/d	n/d	0.1=0	n/d	yes n/d	n/d	n/d
DM-600IS-CH2O	330=4	330=34	330=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	330=17	n/d
DM-600IS-GeH4	n/d	n/d	n/d	n/d	n/d	100=<1	n/d	n/d	0.2=0.1	n/d	n/d	n/d	n/d
DM-600IS-N2H4	n/d	n/d	n/d	1000=0	n/d	200=0.04	n/d	n/d	0.1=0.1	n/d	n/d	n/d	n/d
DM-600IS-H2 (ppm)	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-H2 (LEL)	n/d	n/d	n/d	n/d	n/d	100=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HBr	n/d	n/d	n/d	1000=0	No	n/d	n/d	n/d	0.1=0.3	n/d	n/d	n/d	n/d
DM-600IS-HCL	n/d	n/d	n/d	1000=0	No	n/d	n/d	n/d	0.1=0.3	n/d	n/d	n/d	n/d
DM-600IS-HCN	n/d	n/d	n/d	1000=0	n/d	n/d	n/d	n/d	0.1=0	n/d	yes n/d	n/d	n/d
DM-600IS-HF	n/d	n/d	n/d	1000=0	n/d	n/d	yes n/d	yes n/d	0.1=0	yes n/d	n/d	n/d	n/d
DM-600IS-H2S	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH3OH	415=4	415=34	415=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	415=17	n/d
DM-600IS-CH3SH	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	275=17	n/d
DM-600IS-NO	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-O3	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	0.1=0.0	n/d	yes n/d	n/d	n/d
DM-600IS-COCL2	n/d	n/d	n/d	1000=0	n/d	50=0.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-PH3	n/d	n/d	n/d	n/d	n/d	100=0.01	n/d	n/d	1=1	n/d	n/d	n/d	n/d
DM-600IS-SiH4	n/d	n/d	n/d	n/d	n/d	100=<1	n/d	n/d	0.2=0.1	n/d	n/d	n/d	n/d
DM-600IS-SO2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H8S	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H4S	45=40	45=340	45=75	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	45=170	1%=1.
DM-600IS-C6H5CH3	55=40	55=340	55=75	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	55=170	n/d
DM-600IS-C4H6O2	200=4	200=34	200=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	200=17	n/d
DM-600IS-C2H3CL	200=4	200=34	200=7	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	200=17	n/d

n/a = not applicable

n/d = no data

Interference Gas Table (page 2 of 5)

Model Number	CO2	CS2	CO	COS	CL2	CLO2	CLF3	B2H6	C2H6S	Si2H6	C3H5OC	C2H5O
DM-600IS-C2H3O	n/d	40=140	40=100	40=135	n/d	n/d	n/d	n/d	40=150	n/d	40=50	40=180
DM-600IS-C2H2	n/d	340=14	340=100	340=13	n/d	n/d	n/d	n/d	340=15	n/d	340=50	340=18
DM-600IS-C3H3N	n/d	75=140	75=100	75=135	n/d	n/d	n/d	n/d	75=150	n/d	75=50	75=180
DM-600IS-NH3 (-5000=0 20°C)	n/d	n/d	1000=0	n/d	1=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-501IS-NH3 (-5000=0 40°C)	n/d	n/d	300=100	n/d	5=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-502IS-NH3 (CE)	n/d	n/d	300=8	n/d	1=1	10%=15	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-AsH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-Br2	n/d	n/d	300=0	n/d	1=2	1=6	n/d	n/d	n/d	n/d	n/a	n/d
DM-600IS-C4H6	n/d	170=14	170=100	170=13	n/d	n/d	n/d	n/d	170=15	n/d	170=50	170=18
DM-600IS-CS2	n/d	n/a	140=100	140=13	n/d	n/d	n/d	n/d	140=15	n/d	140=50	140=18
DM-600IS-CO	n/d	n/d	n/a	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	200=0
DM-600IS-COS	n/d	135=14	135=100	n/a	n/d	n/d	n/d	n/d	135=15	n/d	135=50	135=18
DM-600IS-CL2	n/d	n/d	300=0	n/d	n/a	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CLO2	n/d	n/d	300=0	n/d	3=1	n/a	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-CLO2	5000=	n/d	1000=0	n/d	1=0.9	n/a	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-B2H6	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	n/a	n/d	5=yes	n/d	n/d
DM-600IS-C2H6S	n/d	150=14	150=100	150=13	n/d	n/d	n/d	n/d	n/a	n/d	150=50	150=18
DM-600IS-C3H5OCL	n/d	50=140	50=100	50=135	n/d	n/d	n/d	n/d	50=150	n/d	n/a	50=180
DM-600IS-C2H5OH	n/d	180=14	180=100	180=13	n/d	n/d	n/d	n/d	180=15	n/d	180=50	n/a
DM-600IS-C2H5SH	n/d	n/d	300≤5	n/d	1 = -0.6	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H4	n/d	220=14	220=100	220=13	n/d	n/d	n/d	n/d	220=15	n/d	220=50	220=18
DM-600IS-C2H4O	n/d	275=14	275=100	275=13	n/d	n/d	n/d	n/d	275=15	n/d	275=50	275=18
DM-600IS-F2	5000=	n/d	1000=0	n/d	1=1.3	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH2O	n/d	330=14	330=100	330=13	n/d	n/d	n/d	n/d	330=15	n/d	330=50	330=18
DM-600IS-GeH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-N2H4	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-H2 (ppm)	n/d	n/d	300=<30	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-601IS-H2 (LEL)	1000=0	n/d	50=6	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HBr	5000=	n/d	1000=0	n/d	5=1	n/d	yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCL	5000=	n/d	1000=0	n/d	5=1	n/d	1=yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCN	5000=	n/d	1000=0	n/d	5 = -1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HF	5000=	n/d	1000=0	n/d	1=0.4	n/d	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-H2S	n/d	n/d	300=≤1.5	n/d	1 = ≈ -0.2	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH3OH	n/d	415=14	415=100	415=13	n/d	n/d	n/d	n/d	415=15	n/d	415=50	415=18
DM-600IS-CH3SH	n/d	n/d	300≤3	n/d	1 = -0.4	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO	n/d	n/d	300=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO2	n/d	n/d	300=0	n/d	1=≈1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-O3	5000=	n/d	300=0	n/d	1=1.4	0.1=0.1	1=1(theor	n/d	n/d	n/d	n/d	n/d
DM-600IS-COCL2	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-PH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SiH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SO2	n/d	n/d	300=<5	n/d	1=<0.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H8S	5000=	n/d	0.1%=1.	1%=10	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H4S	n/d	45=140	45=100	45=135	n/d	n/d	n/d	n/d	45=150	n/d	45=50	45=180
DM-600IS-C6H5CH3	n/d	55=140	55=100	55=135	n/d	n/d	n/d	n/d	55=150	n/d	55=50	55=180
DM-600IS-C4H6O2	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18
DM-600IS-C2H3CL	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18

n/a = not applicable

n/d = no data

Interference Gas Table (page 3 of 5)

Model Number	CO2	CS2	CO	COS	CL2	CL02	CLF3	B2H6	C2H6S	Si2H6	C3H5OC	C2H5O
DM-600IS-C2H3O	n/d	40=140	40=100	40=135	n/d	n/d	n/d	n/d	40=150	n/d	40=50	40=180
DM-600IS-C2H2	n/d	340=14	340=100	340=13	n/d	n/d	n/d	n/d	340=15	n/d	340=50	340=18
DM-600IS-C3H3N	n/d	75=140	75=100	75=135	n/d	n/d	n/d	n/d	75=150	n/d	75=50	75=180
DM-600IS-NH3 (-20°C)	5000=0	n/d	1000=0	n/d	1=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-501IS-NH3 (-40°C)	5000=0	n/d	300=100	n/d	5=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-502IS-NH3 (CE)	n/d	n/d	300=8	n/d	1=1	10%=15	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-AsH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-Br2	n/d	n/d	300=0	n/d	1=2	1=6	n/d	n/d	n/d	n/d	n/a	n/d
DM-600IS-C4H6	n/d	170=14	170=100	170=13	n/d	n/d	n/d	n/d	170=15	n/d	170=50	170=18
DM-600IS-CS2	n/d	n/a	140=100	140=13	n/d	n/d	n/d	n/d	140=15	n/d	140=50	140=18
DM-600IS-CO	n/d	n/d	n/a	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	200=0
DM-600IS-COS	n/d	135=14	135=100	n/a	n/d	n/d	n/d	n/d	135=15	n/d	135=50	135=18
DM-600IS-CL2	n/d	n/d	300=0	n/d	n/a	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CLO2	n/d	n/d	300=0	n/d	3=1	n/a	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-CLO2	5000=	n/d	1000=0	n/d	1=0.9	n/a	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-B2H6	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	n/a	n/d	5=yes	n/d	n/d
DM-600IS-C2H6S	n/d	150=14	150=100	150=13	n/d	n/d	n/d	n/d	n/a	n/d	150=50	150=18
DM-600IS-C3H5OCL	n/d	50=140	50=100	50=135	n/d	n/d	n/d	n/d	50=150	n/d	n/a	50=180
DM-600IS-C2H5OH	n/d	180=14	180=100	180=13	n/d	n/d	n/d	n/d	180=15	n/d	180=50	n/a
DM-600IS-C2H5SH	n/d	n/d	300≤5	n/d	1 = -0.6	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H4	n/d	220=14	220=100	220=13	n/d	n/d	n/d	n/d	220=15	n/d	220=50	220=18
DM-600IS-C2H4O	n/d	275=14	275=100	275=13	n/d	n/d	n/d	n/d	275=15	n/d	275=50	275=18
DM-600IS-F2	5000=	n/d	1000=0	n/d	1=1.3	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH2O	n/d	330=14	330=100	330=13	n/d	n/d	n/d	n/d	330=15	n/d	330=50	330=18
DM-600IS-GeH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-N2H4	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-H2 (ppm)	n/d	n/d	300=<30	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-601IS-H2 (LEL)	1000=0	n/d	50=6	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HBr	5000=	n/d	1000=0	n/d	5=1	n/d	yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCL	5000=	n/d	1000=0	n/d	5=1	n/d	1=yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCN	5000=	n/d	1000=0	n/d	5 = -1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HF	5000=	n/d	1000=0	n/d	1=0.4	n/d	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-H2S	n/d	n/d	300=≤1.5	n/d	1 = ≈ -0.2	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH3OH	n/d	415=14	415=100	415=13	n/d	n/d	n/d	n/d	415=15	n/d	415=50	415=18
DM-600IS-CH3SH	n/d	n/d	300≤3	n/d	1 = -0.4	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO	n/d	n/d	300=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO2	n/d	n/d	300=0	n/d	1=≈1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-O3	5000=	n/d	300=0	n/d	1=1.4	0.1=0.1	1=1(theor	n/d	n/d	n/d	n/d	n/d
DM-600IS-COCL2	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-PH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SiH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SO2	n/d	n/d	300=<5	n/d	1=<0.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H8S	5000=	n/d	0.1%=1.	1%=10	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H4S	n/d	45=140	45=100	45=135	n/d	n/d	n/d	n/d	45=150	n/d	45=50	45=180
DM-600IS-C6H5CH3	n/d	55=140	55=100	55=135	n/d	n/d	n/d	n/d	55=150	n/d	55=50	55=180
DM-600IS-C4H6O2	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18
DM-600IS-C2H3CL	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18

n/a = not applicable
n/d = no data

Interference Gas Table (page 4 of 5)

Model Number	CO2	CS2	CO	COS	CL2	CLO2	CLF3	B2H6	C2H6S	Si2H6	C3H5OC	C2H5O
DM-600IS-C2H3O	n/d	40=140	40=100	40=135	n/d	n/d	n/d	n/d	40=150	n/d	40=50	40=180
DM-600IS-C2H2	n/d	340=14	340=100	340=13	n/d	n/d	n/d	n/d	340=15	n/d	340=50	340=18
DM-600IS-C3H3N	n/d	75=140	75=100	75=135	n/d	n/d	n/d	n/d	75=150	n/d	75=50	75=180
DM-600IS-NH3 (-5000=0 20°C)	n/d	n/d	1000=0	n/d	1=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-501IS-NH3 (-5000=0 40°C)	n/d	n/d	300=100	n/d	5=0	n/d	n/d	0.1=0	n/d	n/d	n/d	n/d
DM-502IS-NH3 (CE)	n/d	n/d	300=8	n/d	1=1	10%=15	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-AsH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-Br2	n/d	n/d	300=0	n/d	1=2	1=6	n/d	n/d	n/d	n/d	n/a	n/d
DM-600IS-C4H6	n/d	170=14	170=100	170=13	n/d	n/d	n/d	n/d	170=15	n/d	170=50	170=18
DM-600IS-CS2	n/d	n/a	140=100	140=13	n/d	n/d	n/d	n/d	140=15	n/d	140=50	140=18
DM-600IS-CO	n/d	n/d	n/a	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	200=0
DM-600IS-COS	n/d	135=14	135=100	n/a	n/d	n/d	n/d	n/d	135=15	n/d	135=50	135=18
DM-600IS-CL2	n/d	n/d	300=0	n/d	n/a	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CLO2	n/d	n/d	300=0	n/d	3=1	n/a	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-CLO2	5000=	n/d	1000=0	n/d	1=0.9	n/a	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-B2H6	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	n/a	n/d	5=yes	n/d	n/d
DM-600IS-C2H6S	n/d	150=14	150=100	150=13	n/d	n/d	n/d	n/d	n/a	n/d	150=50	150=18
DM-600IS-C3H5OCL	n/d	50=140	50=100	50=135	n/d	n/d	n/d	n/d	50=150	n/d	n/a	50=180
DM-600IS-C2H5OH	n/d	180=14	180=100	180=13	n/d	n/d	n/d	n/d	180=15	n/d	180=50	n/a
DM-600IS-C2H5SH	n/d	n/d	300≤5	n/d	1 = -0.6	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H4	n/d	220=14	220=100	220=13	n/d	n/d	n/d	n/d	220=15	n/d	220=50	220=18
DM-600IS-C2H4O	n/d	275=14	275=100	275=13	n/d	n/d	n/d	n/d	275=15	n/d	275=50	275=18
DM-600IS-F2	5000=	n/d	1000=0	n/d	1=1.3	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH2O	n/d	330=14	330=100	330=13	n/d	n/d	n/d	n/d	330=15	n/d	330=50	330=18
DM-600IS-GeH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-N2H4	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-H2 (ppm)	n/d	n/d	300=<30	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-601IS-H2 (LEL)	1000=0	n/d	50=6	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HBr	5000=	n/d	1000=0	n/d	5=1	n/d	yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCL	5000=	n/d	1000=0	n/d	5=1	n/d	1=yes n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCN	5000=	n/d	1000=0	n/d	5 = -1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HF	5000=	n/d	1000=0	n/d	1=0.4	n/d	yes n/d	0.1=0	n/d	n/d	n/d	n/d
DM-600IS-H2S	n/d	n/d	300=≤1.5	n/d	1 = ≈ -0.2	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH3OH	n/d	415=14	415=100	415=13	n/d	n/d	n/d	n/d	415=15	n/d	415=50	415=18
DM-600IS-CH3SH	n/d	n/d	300≤3	n/d	1 = -0.4	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO	n/d	n/d	300=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO2	n/d	n/d	300=0	n/d	1=≈1	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-O3	5000=	n/d	300=0	n/d	1=1.4	0.1=0.1	1=1(theor	n/d	n/d	n/d	n/d	n/d
DM-600IS-COCL2	5000=	n/d	1000=0	n/d	1=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-PH3	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SiH4	5000=	n/d	300=0	n/d	0.5 =	n/d	n/d	0.2=0.1	n/d	5=yes	n/d	n/d
DM-600IS-SO2	n/d	n/d	300=<5	n/d	1=<0.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H8S	5000=	n/d	0.1%=1.	1%=10	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H4S	n/d	45=140	45=100	45=135	n/d	n/d	n/d	n/d	45=150	n/d	45=50	45=180
DM-600IS-C6H5CH3	n/d	55=140	55=100	55=135	n/d	n/d	n/d	n/d	55=150	n/d	55=50	55=180
DM-600IS-C4H6O2	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18
DM-600IS-C2H3CL	n/d	200=14	200=100	200=13	n/d	n/d	n/d	n/d	200=15	n/d	200=50	200=18

n/a = not applicable

n/d = no data

Interference Gas Table (page 5 of 5)

Model Number	PH3	PF3	SiH4	Si	SiF4	SO2	C4H8	C4H4S	C6H5CH	WF6	C4H6O	C2H3C	C2H5S	C6H5CH
DM-600IS-C2H3O	n/d	n/d	n/d	n/d	n/d	n/d	n/d	40=45	n/d	n/d	40=200	40=200	n/d	40=55
DM-600IS-C2H2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	340=4	n/d	n/d	340=20	340=20	n/d	340=55
DM-600IS-C3H3N	n/d	n/d	n/d	n/d	n/d	n/d	n/d	75=45	n/d	n/d	75=200	75=200	n/d	75=55
DM-600IS-NH3 (-300=0 20°C)	n/d	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-NH3 (-0.3=0 40°C)	n/d	n/d	n/d	n/d	n/d	yes n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-502IS-NH3	n/d	n/d	n/d	n/d	n/d	5= -0.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-AsH3	0.1=0.1	n/d	1=0.56	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-Br2	n/d	n/d	n/d	n/d	n/d	5= -0.1	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H6	n/d	n/d	n/d	n/d	n/d	n/d	n/d	170=4	n/d	n/d	170=20	170=20	n/d	170=55
DM-600IS-CS2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	140=4	n/d	n/d	140=20	140=20	n/d	140=55
DM-600IS-CO	n/d	n/d	n/d	n/d	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-COS	n/d	n/d	n/d	n/d	n/d	n/d	n/d	135=4	n/d	n/d	135=20	135=20	n/d	135=55
DM-600IS-CL2	n/d	n/d	n/d	n/d	n/d	5=-0.05	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CLO2 (>10ppm)	n/d	n/d	n/d	n/d	n/d	5=-0.016	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-CLO2 (<10ppm)	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-B2H6	0.1=0.1	n/d	1=0.72	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H6S	n/d	n/d	n/d	n/d	n/d	n/d	n/d	150=4	n/d	n/d	150=20	150=20	n/d	150=55
DM-600IS-	n/d	n/d	n/d	n/d	n/d	n/d	n/d	50=45	n/d	n/d	50=200	50=200	n/d	50=55
DM-600IS-C2H5OH	n/d	n/d	n/d	n/d	n/d	n/d	n/d	180=4	n/d	n/d	180=20	180=20	n/d	180=55
DM-600IS-C2H5SH	n/d	n/d	n/d	n/d	n/d	5=<3	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C2H4	n/d	n/d	n/d	n/d	n/d	n/d	n/d	220=4	n/d	n/d	220=20	220=20	n/d	220=55
DM-600IS-C2H4O	n/d	n/d	n/d	n/d	n/d	n/d	n/d	275=4	n/d	n/d	275=20	275=20	n/d	275=55
DM-600IS-F2	n/d	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-CH2O	n/d	n/d	n/d	n/d	n/d	n/d	n/d	330=4	n/d	n/d	330=20	330=20	n/d	330=55
DM-600IS-GeH4	0.1=0.1	n/d	1=1	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-N2H4	0.3=0.1	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-H2 (ppm)	n/d	n/d	n/d	n/d	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-501IS-H2 (LEL)	n/d	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HBr	0.1=0.3	n/d	n/d	n/d	n/d	5=2.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCL	0.1=0.3	n/d	n/d	n/d	n/d	5=2.5	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HCN	0.3=0	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-HF	0.1=0	yes n/d	n/d	n/d	3=4 (theor.)	yes n/d	n/d	n/d	n/d	yes n/d	n/d	n/d	n/d	n/d
DM-600IS-H2S	n/d	n/d	n/d	n/d	n/d	5=<1	n/d	n/d	n/d	n/d	n/d	n/d	3=1	n/d
DM-600IS-CH3OH	n/d	n/d	n/d	n/d	n/d	n/d	n/d	415=4	n/d	n/d	415=20	415=20	n/d	415=55
DM-600IS-CH3SH	n/d	n/d	n/d	n/d	n/d	5=<2	n/d	n/d	n/d	n/d	n/d	n/d	2=1	n/d
DM-600IS-NO	n/d	n/d	n/d	n/d	n/d	5=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-NO2	n/d	n/d	n/d	n/d	n/d	5=	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-O3	0.3=0.0	n/d	1=0.01	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-COCL2	0.3=0	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-PH3	n/a	n/d	1=0.56	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-SiH4	0.1=0.1	n/d	n/d	n/d	n/d	2=0	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-SO2	n/d	n/d	n/d	n/d	n/d	n/a	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H8S	n/d	n/d	n/d	n/d	n/d	2=0.6	n/d	n/a	n/d	n/d	n/d	n/d	n/d	n/d
DM-600IS-C4H4S	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	n/d	45=200	45=200	n/d	45=55
DM-600IS-	n/d	n/d	n/d	n/d	n/d	n/d	n/d	55=45	n/d	n/d	55=200	n/d	n/d	n/a
DM-600IS-C4H6O2	n/d	n/d	n/d	n/d	n/d	n/d	n/d	200=4	n/d	n/d	n/a	200=20	n/d	200=55
DM-600IS-C2H3CL	n/d	n/d	n/d	n/d	n/d	n/d	n/d	200=4	n/d	n/d	200=20	n/a	n/d	200=55

n/a = not applicable

n/d = no data

4.0 Specifications

Method of Detection

Electrochemical Cell

Electrical Classification

CSA-NRTL (US OSHA) approved* Class 1; Groups B, C, D; Div. 1.

Input Voltage

22.5-28 VDC

Power Consumption

Normal operation = 44 mA (1.1 watts @ 24VDC); Maximum @ 24VDC = 120 mA (2.9 watts)

Maximum @ 22.5VDC = 102 mA (2.3 watts)

Output

3 relays (alarm 1, alarm 2, and fault) contact rated 5 amps @ 125 VAC,

5 amps @ 30 VDC Linear 4-20 mA DC; RS-485 Modbus™

Repeatability

± 2% FS

Table 2 Sensor cell specifications

Model Number	Gas Name	Response Time(seconds)	Span Drift	Temperature Range °C	Temperature Range °F	Humidity Range %	Sensor Cal Warranty
DM-600IS-C2H3O	Acetaldehyde	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C2H2	Acetylene	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C3H3N	Acrylonitrile	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-NH3 (-20°C)	Ammonia	T90 <60	<1% signal loss/month	-20 to +40	-4 to +104	10 to 95	2 years
DM-601IS-NH3 (-40°C)	Ammonia	T90 <90	<2% signal loss/month	-40 to +40	-40 to +104	5 to 95	2 years
DM-602IS-NH3 (CE)	Ammonia	T90 <90	<2% signal loss/month	-40 to +50	-40 to +122	15 to 90	2 years
DM-600IS-Ash3	Arsine	T90 <60	<5% signal loss/month	-20 to +40	-4 to +104	20 to 95	11/2 years
DM-600IS-Br2	Bromine	T90 <60	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C4H6	Butadiene	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-CS2	Carbon Disulfide	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-CO	Carbon Monoxide	T90 ≤30	<5% signal loss/year	-40 to +50	-40 to +122	15 to 90	3 years
DM-600IS-COS	Carbonyl Sulfide	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-CL2	Chlorine	T90 <60	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-CLO2 (>10ppm)	Chlorine Dioxide	T90 <60	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years
DM-501IS-CLO2 (≤10ppm)	Chlorine Dioxide	T90 <120	<1% signal loss/month	-20 to +40	-4 to +104	10 to 95	2 years
DM-600IS-B2H6	Diborane	T90 <60	<5% signal loss/month	-20 to +40	-4 to +104	20 to 95	1-1/2 years
DM-600IS-C2H6S	Dimethyl Sulfide	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C3H5OCL	Epichlorohydrin	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C2H5OH	Ethanol	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C2H5SH	Ethyl Mercaptan	T90 <45	<2% signal loss/month	-40 to +50	-40 to +122	15 to 90	2 years
DM-600IS-C2H4	Ethylene	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C2H4O	Ethylene Oxide	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-F2	Fluorine	T90 <80	<5% signal loss/year	-10 to +40	+14 to +104	10 to 95	1-1/2 years
DM-600IS-CH2O	Formaldehyde	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-GeH4	Germane	T90 <60	<1% signal loss/month	-20 to +40	-4 to +104	20 to 95	1-1/2 years
DM-600IS-N2H4	Hydrazine	T90 <120	<5% signal loss/month	-10 to +40	+14 to +104	10 to 95	1 year
DM-600IS-H2 (ppm)	Hydrogen	T90 ≤30	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years
DM-501IS-H2 (LEL)*	Hydrogen	T90 <60	<2% signal loss/month	-40 to +40	-40 to +104	5 to 95	2 years
DM-600IS-HBr	Hydrogen Bromide	T90 <70	<3% signal loss/month	-20 to +40	-4 to +104	10 to 95	1-1/2 years
DM-600IS-HCL	Hydrogen Chloride	T90 <70	<2% signal loss/month	-20 to +40	-4 to +104	10 to 95	1-1/2 years
DM-600IS-HCN	Hydrogen Cyanide	T90 <40	<5% signal loss/month	-40 to +40	-40 to +104	5 to 95	2 years
DM-600IS-HF	Hydrogen Fluoride	T90 <90	<10% signal loss/month	-20 to +35	-4 to +95	10 to 80	1-1/2 years
DM-600IS-H2S	Hydrogen Sulfide	T90 ≤30	<2% signal loss/month	-40 to +50	-40 to +122	15 to 90	2 years
DM-600IS-CH3OH	Methanol	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-CH3SH	Methyl Mercaptan	T90 <45	<2% signal loss/month	-40 to +50	-40 to +122	15 to 90	2 years
DM-600IS-NO	Nitric Oxide	T90 ≤10	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	3 years
DM-600IS-NO2	Nitrogen Dioxide	T90 <40	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-O3	Ozone	T90 <120	<1% signal loss/month	-10 to +40	+14 to +104	10 to 95	2 years
DM-600IS-COCL2	Phosgene	T90 <120	<1% signal loss/month	-20 to +40	-4 to +104	10 to 95	1-1/2 years
DM-600IS-PH3	Phosphine	T90 <30	<1% signal loss/month	-20 to +40	-4 to +104	20 to 95	1-1/2 years
DM-600IS-SiH4	Silane	T90 <60	<1% signal loss/month	-20 to +40	-4 to +104	20 to 95	1-1/2 years
DM-600IS-SO2	Sulfur Dioxide	T90 ≤20	<2% signal loss/month	-20 to +50	-4 to +122	15 to 90	2 years

DM-600IS-C4H8S	Tetrahydrothiophene	T90 <30	<2% signal loss/month	-10 to +40	+14 to +104	10 to 95	2 years
DM-600IS-C4H4S	Thiophane	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C6H5CH3	Toluene	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C4H6O2	Vinyl Acetate	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years
DM-600IS-C2H3CL	Vinyl Chloride	T90 <140	<5% signal loss/year	-20 to +50	-4 to +122	15 to 90	2 years

*LEL range H2 is not CSA approved.

5.0 Installation

Optimum performance of ambient air/gas sensor devices is directly relative to proper location and installation practice.

5.1 Field Wiring Table (4-20 mA output)

Detcon Model DM-600IS toxic gas sensor assemblies require three conductor connection between power supplies and host electronic controllers. Wiring designators are + (DC), - (DC), and mA (sensor signal). Maximum single conductor resistance between sensor and controller is 10 ohms. Maximum wire size for termination in the sensor assembly terminal board is 14 gauge.

AWG	Meters	Feet
18	360	1200
16	600	2000
14	900	3000

Table 3 Field wiring Table

Note1: This wiring table is based on stranded tinned copper wire and is designed to serve as a reference only.

Note2: Shielded cable may be required in installations where cable trays or conduit runs include high voltage lines or other sources of induced interference.

Note3: The supply of power must be from an isolating source with over-current protection as follows:

AWG	Over-current Protection	AWG	Over-current Protection
22	3A	16	10A
20	5A	14	20A
18	7A	12	25A

Table 4 Over-current Protection per AWG

The RS-485 (if applicable) requires 24 gauge, two conductor, shielded, twisted pair cable between sensor and host PC. Use Belden part number 9841. Two sets of terminals are located on the connector board to facilitate serial loop wiring from sensor to sensor. Wiring designators are **A & B (IN)** and **A & B (OUT)**.

5.2 Sensor Location

Selection of sensor location is critical to the overall safe performance of the product. Five factors play an important role in selection of sensor locations:

- 1) Density of the gas to be detected
- 2) Most probable leak sources within the industrial process
- 3) Ventilation or prevailing wind conditions
- 4) Personnel exposure
- 5) Maintenance access

Density - Placement of sensors relative to the density of the target gas is such that sensors for the detection of heavier than air gases should be located within 2-4 feet of grade as these heavy gases will tend to settle in low lying areas. For gases lighter than air, sensor placement should be 4-8 feet above grade in open areas or in pitched areas of enclosed spaces.

Leak Sources - Most probable leak sources within an industrial process include flanges, valves, and tubing connections of the sealed type where seals may either fail or wear. Other leak sources are best determined by facility engineers with experience in similar processes.

Ventilation - Normal ventilation or prevailing wind conditions can dictate efficient location of gas sensors in a manner where the migration of gas clouds is quickly detected.

Personnel Exposure - The undetected migration of gas clouds should not be allowed to approach concentrated personnel areas such as control rooms, maintenance or warehouse buildings. A more general and applicable thought toward selecting sensor location is combining leak source and perimeter protection in the best possible configuration.

Maintenance Access

Consideration should be given to easy access by maintenance personnel as well as the consequences of close proximity to contaminants that may foul the sensor prematurely.

Note: In all installations, the sensor element in SS housing points down relative to grade (Figure 6). Improper sensor orientation may result in false reading and permanent sensor damage.

Note: In all installations, the sensor element in SS housing points down relative to grade (Figure 6). Improper sensor orientation may result in false reading and permanent sensor damage.

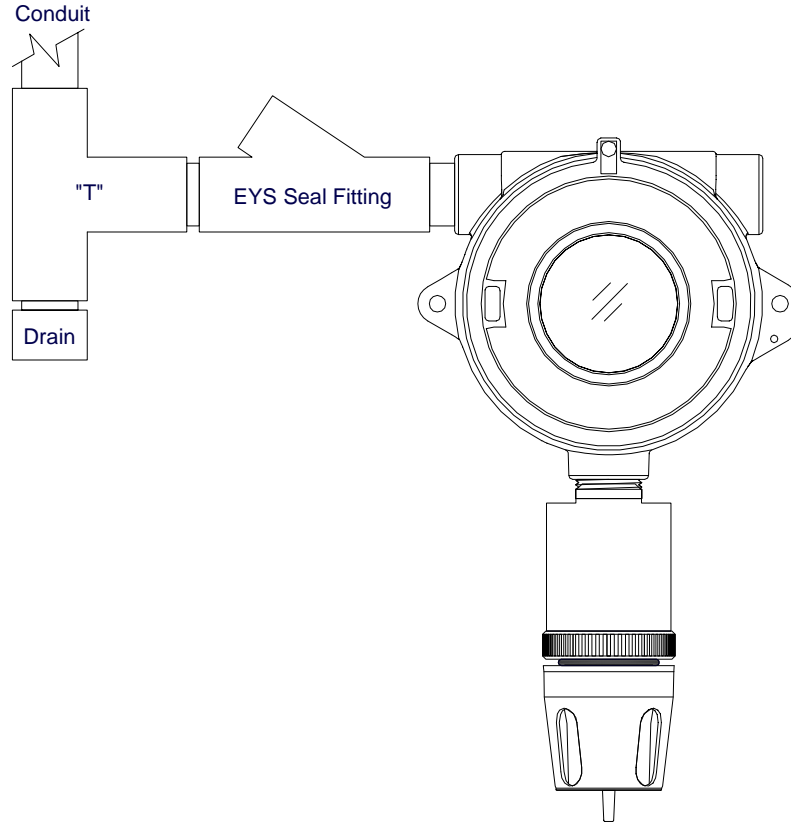


Figure 6 Typical Installation

5.3 Local Electrical Codes

Sensor and transmitter assemblies should be installed in accordance with all local electrical codes. Use appropriate conduit seals. Drains & breathers are recommended. The sensor assemblies are CSA-NRTL approved for Class I; Groups B, C, D; Div. 1 environments.

5.4 Installation Procedure

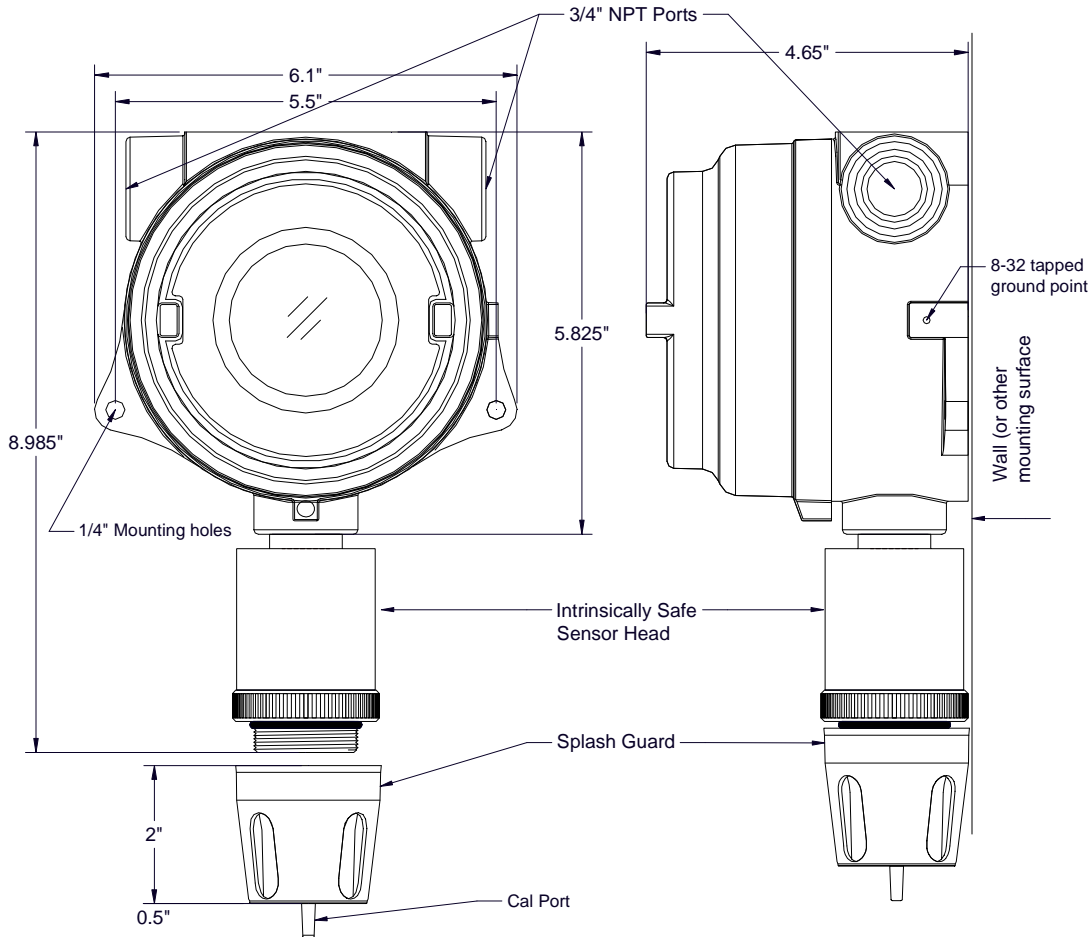


Figure 7 Typical Outline and Mounting Dimensions

- Securely mount the sensor junction box in accordance with recommended practice. See dimensional drawing (Figure 7).
- Remove the junction box cover and un-plug the control circuit by grasping the two thumb screws and pulling outward. Observing correct polarity, connect the loop power field wiring to the terminals labeled “+” and “-” 4-20 mA. (Figure 8) Reinstall cover.
- Observing correct polarity, terminate 3 conductor field wiring, RS-485 wiring, and applicable alarm wiring to the sensor base connector board in accordance with the detail shown in Figure 8. Normally open and normally closed Form C dry contacts (rated 5 amp @ 125VAC; 5 amp @ 30VDC) are provided for Fault, Alarm 1, and Alarm2.

Note: Per U.L. approval, these relays may only be used in connecting to devices that are powered by the same voltages.

- Position gold plated jumper tabs located on the connector board in accordance with desired Form C dry contact outputs: NO = Normally Open; NC = Normally closed (see Figure 8).

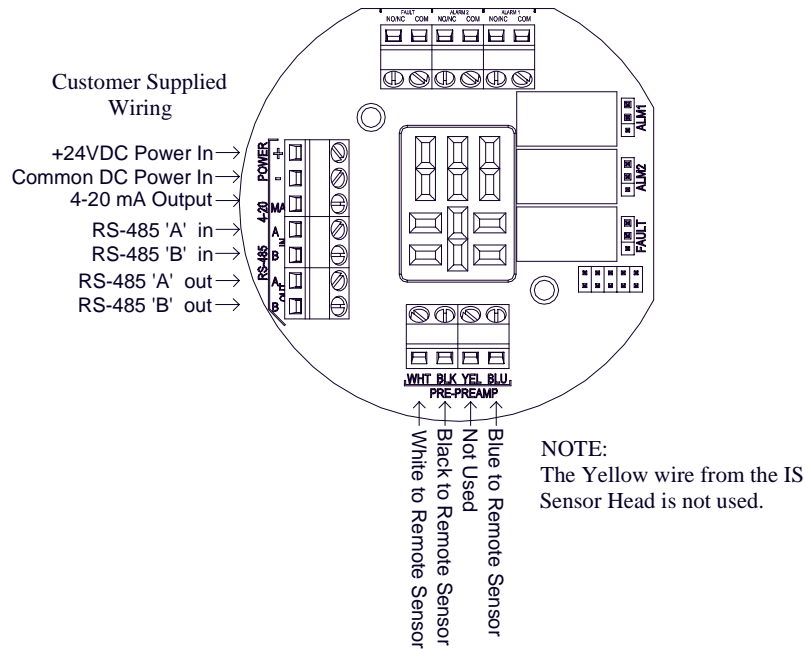


Figure 8 Sensor wiring

Note: If a voltage signal output is desired in place of the 4-20mA output, a 1/4 watt resistor must be installed in position R1 of the terminal board. A 250Ω resistor will provide a 1-5V output (– to mA). A 100Ω resistor will provide a .4-2V output, etc. This linear signal corresponds to 0-100% of scale (See fi

- e. Program the alarms via the gold plated jumper tab positions located on the CPU board (see Figure 9). Alarm 1 and Alarm 2 have three jumper programmable functions: latching/non-latching relays, normally energized/normally de-energized relays, and ascending/descending alarm set points. The fault alarm has two jumper programmable functions: latching/non-latching relay, and normally energized/normally de-energized relay. The default settings of the alarms (jumpers removed) are normally de-energized relays, non-latching relays, and alarm points that activate during descending gas conditions.

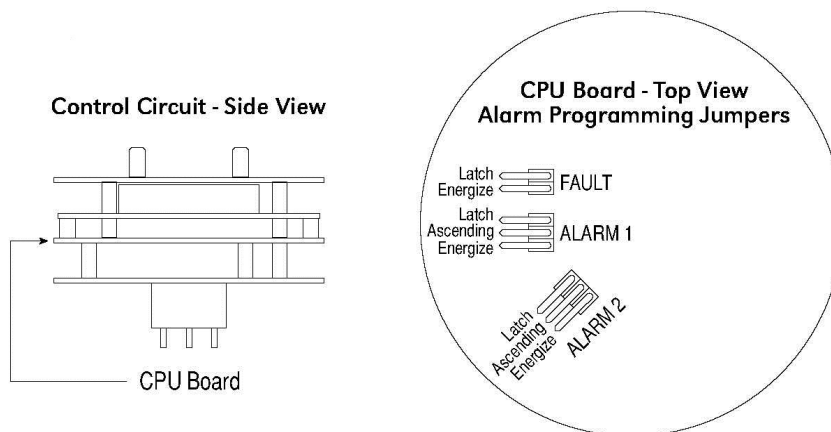


Figure 9 Alarm Programming Jumpers

If a jumper tab is installed in the latch position that alarm relay will be in the latching mode. The latching mode will latch the alarm after alarm conditions have cleared until the alarm reset function is activated. The non-latching mode (jumper removed) will allow alarms to de-activate automatically once alarm conditions have cleared.

If a jumper tab is installed in the energize position, that alarm relay will be in the energized mode. The energized mode will energize or activate the alarm relay when there is no alarm condition and de-energize or de-activate the alarm relay when there is an alarm condition. The de-energized mode (jumper removed) will energize or activate the alarm relay during an alarm condition and de-energize or de-activate the alarm relay when there is no alarm condition.

If a jumper tab is installed in the ascending position that alarm relay will be in the ascending mode. The ascending mode will cause an alarm to fire when the gas concentration detected is greater than or equal to the alarm set point. The descending mode (jumper removed) will cause an alarm to fire when the gas concentration detected is lesser than or equal to the alarm set point. Except in special applications, toxic gas monitoring will require alarms to fire in “ASCENDING” gas conditions.

Any unused jumper tabs should be stored on the connector board on the terminal strip labeled “Unused Jumpers” (see Figure 8).

- f. If applicable, set the RS-485 ID number via the two rotary dip switches located on the preamp board (see Figure 10). There are 256 different ID numbers available which are based on the hexadecimal numbering system. If RS-485 communications are used, each sensor must have its own unique ID number. Use a jeweler’s screwdriver to set the rotary dip switches according to the table listed on the following page. If RS-485 communications are not used, leave the dip switches in the default position which is zero/zero (0)-(0).

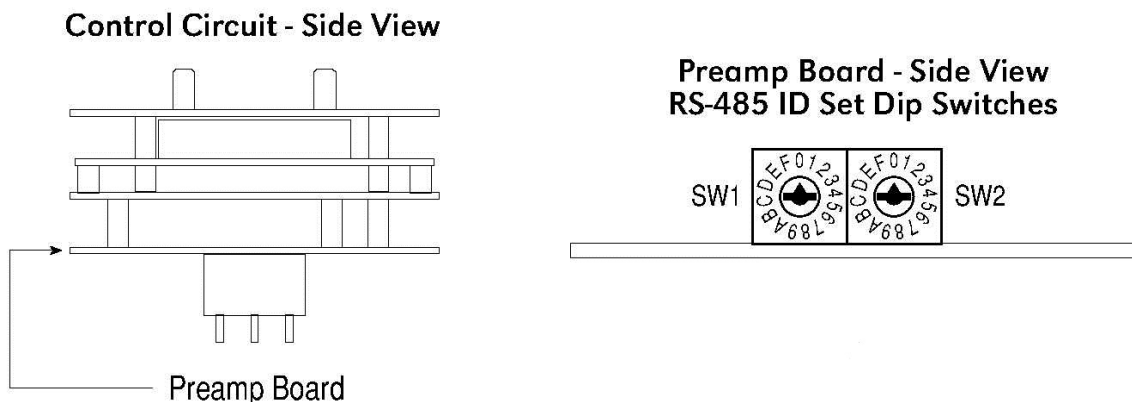


Figure 10 RS-485 ID set Dip Switch

Table 5 RS-485 Rotary Dip Switch Settings

ID#	SW1	SW2	ID#	SW1	SW2	ID#	SW1	SW2	ID#	SW1	SW2	ID#	SW1	SW2
0	0	0	43	2	B	86	5	4	129	8	1	172	A	C
1	0	1	44	2	C	86	5	6	130	8	2	173	A	D
2	0	2	45	2	D	87	5	7	131	8	3	174	A	E
3	0	3	46	2	E	88	5	8	132	8	4	175	A	F
4	0	4	47	2	F	89	5	9	133	8	5	176	B	0
5	0	5	48	3	0	90	5	A	134	8	6	177	B	1
6	0	6	49	3	1	91	5	B	135	8	7	178	B	2
7	0	7	50	3	2	92	5	C	136	8	8	179	B	3
8	0	8	51	3	3	93	5	D	137	8	9	180	B	4
9	0	9	52	3	4	94	5	E	138	8	A	181	B	5
10	0	A	53	3	5	95	5	F	139	8	B	182	B	6
11	0	B	54	3	6	96	6	0	140	8	C	183	B	7
12	0	C	55	3	7	97	6	1	141	8	D	184	B	8
13	0	D	56	3	8	98	6	2	142	8	E	185	B	9
14	0	E	57	3	9	99	6	3	143	8	F	186	B	A
15	0	F	56	3	8	100	6	4	144	9	0	187	B	B
16	1	0	57	3	9	101	6	5	145	9	1	188	B	C
17	1	1	58	3	A	102	6	6	146	9	2	189	B	D
18	1	2	59	3	B	103	6	7	147	9	3	190	B	E
19	1	3	60	3	C	104	6	8	148	9	4	191	B	F
20	1	4	61	3	D	105	6	9	149	9	5	192	C	0
21	1	5	62	3	E	106	6	A	150	9	6	193	C	1
22	1	6	63	3	F	107	6	B	151	9	7	194	C	2
23	1	7	64	4	0	108	6	C	152	9	8	195	C	3
24	1	8	65	4	1	109	6	D	153	9	9	196	C	4
25	1	9	66	4	2	110	6	E	154	9	A	197	C	5
26	1	A	67	4	3	111	6	F	155	9	B	198	C	6
27	1	B	68	4	4	112	7	0	156	9	C	199	C	7
28	1	C	69	4	5	113	7	1	157	9	D	200	C	8
29	1	D	70	4	6	114	7	2	158	9	E	201	C	9
30	1	E	71	4	7	115	7	3	159	9	F	202	C	A
31	1	F	72	4	8	116	7	4	160	A	0	203	C	B
32	2	0	73	4	9	117	7	5	161	A	1	204	C	C
33	2	1	74	4	A	118	7	6	162	A	2	205	C	D
34	2	2	75	4	B	119	7	7	163	A	3	206	C	E
35	2	3	76	4	C	120	7	8	164	A	4	207	C	F
36	2	4	77	4	D	121	7	9	165	A	5	208	D	0
37	2	5	78	4	E	122	7	A	166	A	6	209	D	1
38	2	6	79	4	F	123	7	B	167	A	7	210	D	2
39	2	7	80	5	0	124	7	C	168	A	8	211	D	3
40	2	8	81	5	1	125	7	D	169	A	9	212	D	4
41	2	9	82	5	2	126	7	E	170	A	A	213	D	5
42	2	A	83	5	3	127	7	F	171	A	B	214	D	6

5.5 Remote Mounting Applications

Some sensor mounting applications require that the gas sensor head be remotely mounted away from the sensor transmitter. This is usually true in instances where the gas sensor head must be mounted in a location that is difficult to access. Such a location creates problems for maintenance and calibration activities. Detcon provides the DM-600IS sensor in a remote-mount configuration in which the sensor (Model DM-600IS-RS) and the transmitter (Model DM-600IS-RT) are provided in their own conduit housing and are interfaced together with a four conductor cable. Sensor can be separate from transmitter up to 50 feet using shielded twisted pair cable. Reference Figure 11 for wiring diagram.

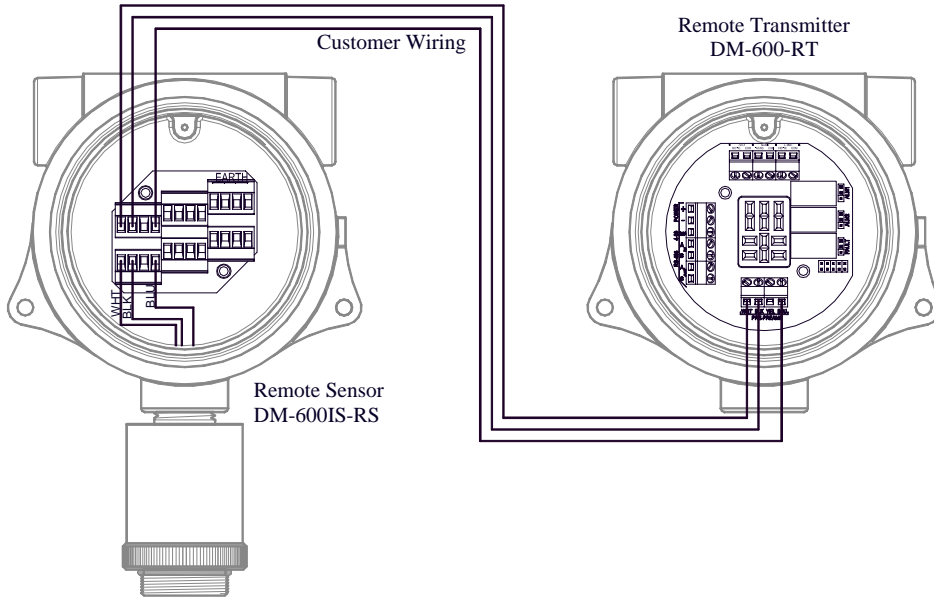


Figure 11 Remote wiring diagram

6.0 Startup

Upon completion of all mechanical mounting and termination of all field wiring, apply system power and observe the following normal conditions:

- a. DM-6xxIS “Fault” LED is off.
- b. A temporary upscale reading will occur as the sensor powers up. This upscale reading will clear to “0” ppm within approximately 30 minutes of turn-on, assuming there is no gas in the area of the sensor.

NOTE 1: If the display contrast needs adjustment, refer to section 15.0.

NOTE 2: Zero Clearing with Biased Cells

Some electrochemical sensors are biased with an excitation voltage. When power to the sensor is lost, this bias voltage slowly decays. When power is restored after long periods (multiple hours) of being unpowered, a surge in sensor output takes place and a long and slow re-establishing of the sensor’s zero baseline takes place. This re-stabilization time may range from 1 hour to 24 hours depending on the type of sensor and range of operation. The sensor types that this applies to are the following: HCl, NO, plus all the VOC sensors, C2H30, C2H2, C3H3N, C4H6, CS2, COS, C2H6S, C3H5OCL, C2H5OH, C2H4, C2H4O, CH2O, CH3OH, C4H4S, C4H6O2, C6H5CH3 and C2H3CL.

If this characteristic is problematic for your specific application, a battery backup or uninterruptible power supply is recommended.

NOTE 3: All alarms will be disabled for 1 minute after power up. In the event of power failure, the alarm disable periods will begin again once power has been restored. If using a biased cell (see note 2 above), this 1 minute delay may likely be inadequate for the signal to clear below alarm levels so manually disabling alarms is advised.

6.1 Initial Operational Tests

After a warm up period has been allowed for, the sensor should be checked to verify sensitivity to its target gas.

Material Requirements

- Detcon PN 943-000006-132 Calibration Adapter
 - Span gas containing the target gas in air or nitrogen. It is recommended that the target gas concentration be 50% of scale at a controlled flow rate of 500 ml/min. For example, a Model DM-600IS-H2S sensor in the range 0-100ppm would require a test gas of 50ppm H2S. For a sensor with a range of 0-10ppm a test gas of 5ppm is recommended, etc.
- a. Attach the calibration adapter to the sensor housing. Apply the test gas at a controlled flow rate of 500 ml/m. Observe that the LCD display increases to a level of 20% of range or higher.
 - b. Remove the test gas and observe that the LCD display decreases to “**0 PPM**”.
 - c. If alarms are activated during the test and have been programmed for latching operation, reset them according to the instructions in section 11.2

Initial operational tests are complete. Detcon toxic gas sensors are pre-calibrated prior to shipment and will, in most cases, not require significant adjustment on start up. However, it is recommended that a complete calibration test and adjustment be performed within 24 hours of installation. Refer to calibration instructions in Section 9.0.

7.0 Operating Software & Magnetic Interface

Operating software is menu listed with operator interface via the two magnetic program switches located under the face plate. The two switches are referred to as “PGM 1” and “PGM 2”. The menu list consists of 3 items which include submenus as indicated below. (Note: see section 8.0 for a complete software flow chart.)

1. Normal Operation
 - a) Current Status
2. Calibration Mode
 - a) Zero
 - b) Span
3. Program Menu
 - a) View Program Status
 - b) Alarm 1 Level
 - c) Alarm 2 Level
 - d) Set Calibration Level

7.1 Normal Operation

In normal operation, the display tracks the current status of the sensor and gas concentration and appears as: “0 PPM xxx” (the “xxx” is the abbreviated gas type, i.e. “0 PPM H₂S”). The mA current output corresponds to the monitoring level of 0-100% of range = 4-20 mA.

7.2 Calibration Mode

Calibration mode allows for sensor zero and span adjustments. “1-ZERO 2-SPAN”

7.2.1 Zero Adjustment

Zero is set in ambient air with no target gas present or with zero gas applied to the sensor. “AUTO ZERO”

7.2.2 Span Adjustment

Span adjustment is performed with a target gas concentration of 50% of range in air or nitrogen. Span gas concentrations other than 50% of range may be used. Refer to section 7.3.4 for details. “AUTO SPAN”

7.3 Program Mode

The program mode provides a program status menu (View Program Status) to check operational parameters. It also allows for the adjustment of the calibration gas level setting.

7.3.1 Program Status

The program status scrolls through a menu that displays:

- The software version number.
- Range is ###
- The alarm set point level of alarm 1. The menu item appears as: “**ALM1 SET @ ##PPM**”
- The alarm firing direction of alarm 1. The menu item appears as: “**ALM1 ASCENDING**” or descending.
- The alarm relay latch mode of alarm 1. The menu item appears as: “**ALM1 NONLATCHING**” or latching.
- The alarm relay energize state of alarm 1. The menu item appears as: “**ALM1 DE-ENERGIZED**” or energized.
- The alarm set point level of alarm 2. The menu item appears as: “**ALM2 SET @ ##PPM**”
- The alarm firing direction of alarm 2. The menu item appears as: “**ALM2 ASCENDING**” or descending.
- The alarm relay latch mode of alarm 2. The menu item appears as: “**ALM2 LATCHING**” or non- latching.
- The alarm relay energize state of alarm 2. The menu item appears as: “**ALM2 DE-ENERGIZED**” or energized.
- The alarm relay latch mode of the fault alarm. The menu item appears as: “**FLT NONLATCHING**” or latching.
- The alarm relay energize state of the fault alarm. The menu item appears as: “**FLT ENERGIZED**” or de-energized.
- The calibration gas level setting. The menu item appears as: “**CalLevel @ xxPPM**”
- Identification of the RS-485 ID number setting. The menu item appears as: “**485 ID SET @ ##**”
- The estimated remaining sensor life. The menu item appears as: “**SENSOR LIFE 100%**”

7.3.2 Alarm 1 Level Adjustment

The alarm 1 level is adjustable from 10% to 90% of range. The menu item appears as: “**SET ALM1 @ ##PPM**”

7.3.3 Alarm 2 Level Adjustment

The alarm 2 level is adjustable from 10% to 90% of range. The menu item appears as: “**SET ALM2 @ ##PPM**”

7.3.4 Calibration Level Adjustment

The calibration level is adjustable from 10% to 90% of range. The menu item appears as: “**CalLevel @ ##PPM**”

7.4 Programming Magnet Operating Instructions

Operator interface to MicroSafe™ gas detection products is via magnetic switches located behind the transmitter face plate. DO NOT remove the glass lens cover to calibrate or change programming parameters. Two switches labeled “PGM 1” and “PGM 2” allow for complete calibration and programming without removing the enclosure cover, thereby eliminating the need for area de-classification or the use of hot permits.



Figure 12 Programming magnet

A magnetic programming tool (see Figure 12) is used to operate the switches. Switch action is defined as momentary contact, 3-second hold, and 30-second hold. In momentary contact use, the programming magnet is waved over a switch location. In 3 second hold, the programming magnet is held in place over a switch location for 3 or more seconds. In 30 second hold, the programming magnet is held in place over a switch location for 30 or more seconds. Three and thirty second hold is used to enter or exit calibration and program menus while momentary contact is used to make adjustments. The location of “PGM 1” and “PGM 2” are shown in Figure 13.

NOTE: If, after entering the calibration or program menus, there is no interaction with the menu items for more than 30 seconds, the sensor will return to its normal operating condition.

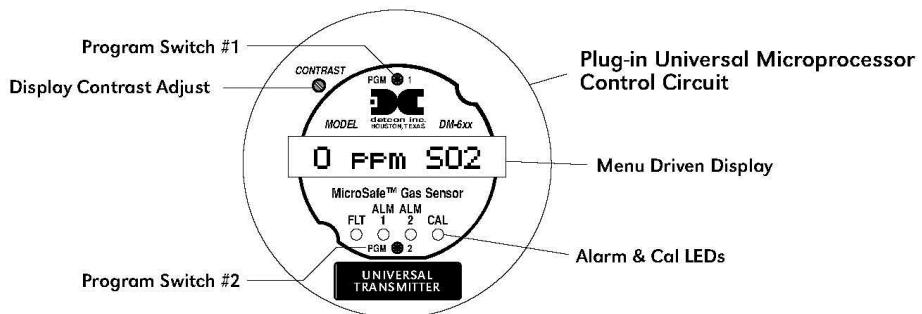


Figure 13 Programming Switch locations

8.0 Software Flow Chart

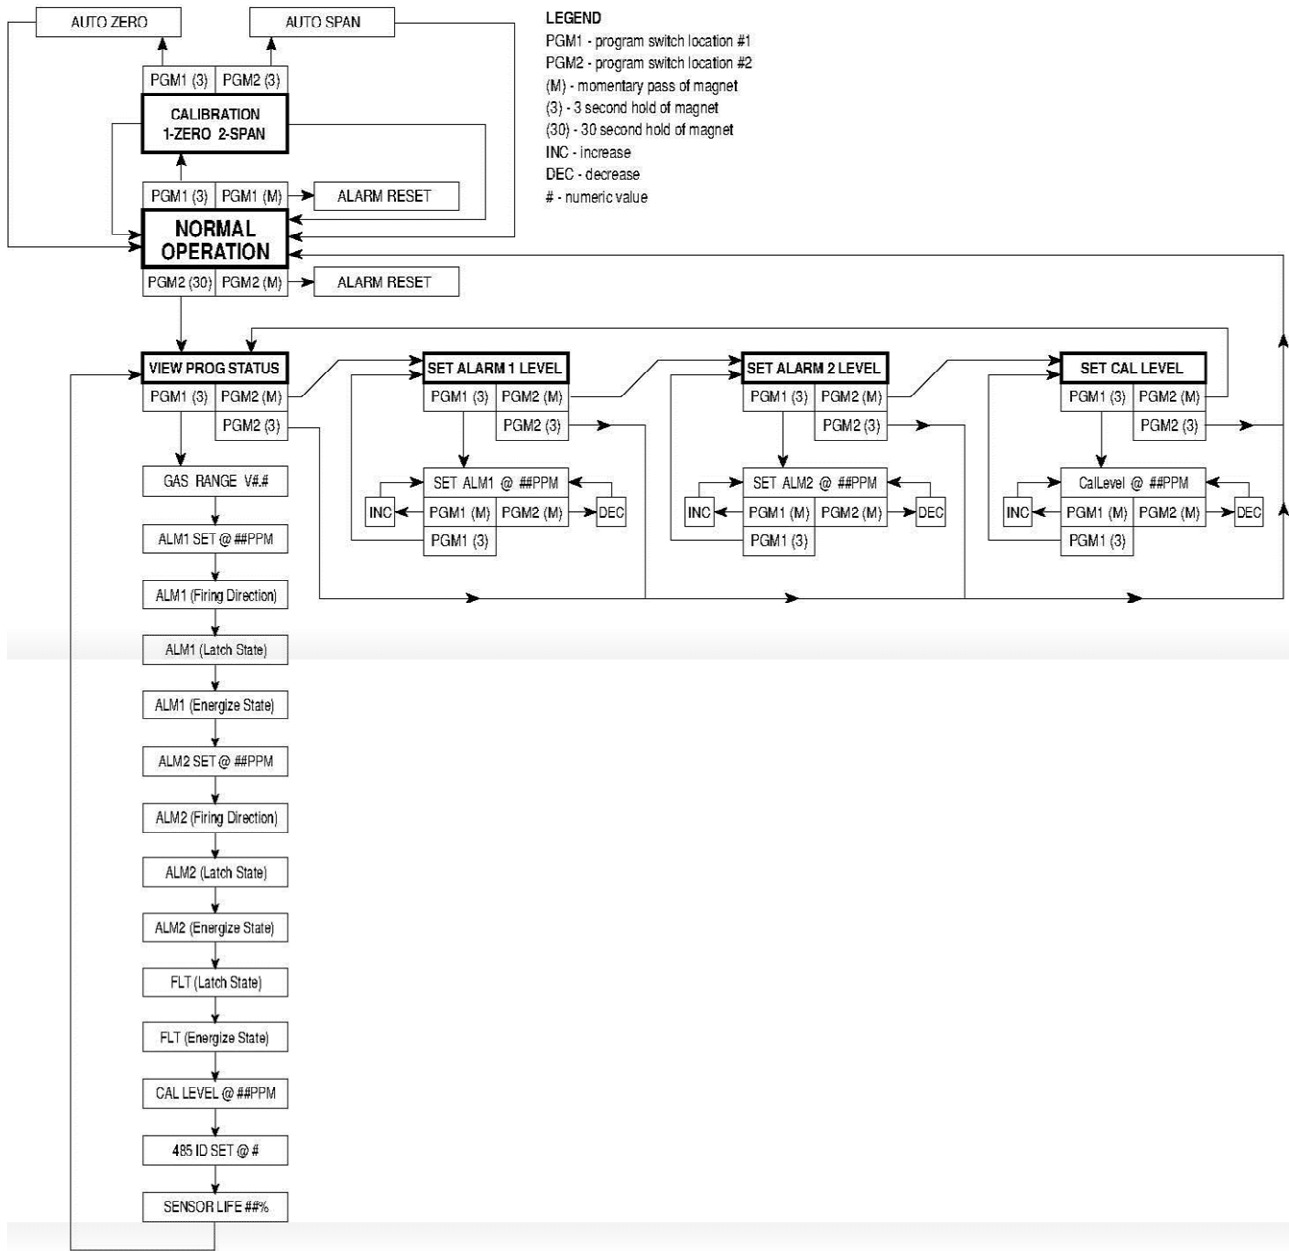


Figure 14 Software Flow Chart

9.0 Calibration

Material Requirements

- Detcon PN 327-000000-000 MicroSafe™ Programming Magnet
- Detcon PN 943-000006-132 Calibration Adapter
- Span gas containing the target gas in air or nitrogen. The target gas concentration is recommended at 50% of range (which is the factory default) at a controlled flow rate of 500 ml/min. Example: for a Model DM-600IS-H₂S sensor with a range of 0-100ppm, a test gas of 50 ppm is recommended. For a sensor with a range of 0-10 ppm a test gas of 5 ppm is recommended, etc. Other concentrations can be used as long as they fall within 10% to 90% of range. See section 9.2 for details. Reference section 10 -2) -b) if you do not know the sensor target gas or range of detection.

9.1 Calibration Procedure – Zero

NOTE: Before performing a zero calibration, be sure there is no background gas present or apply a zero gas standard prior to performing zero calibration.

- Enter the calibration menu by holding the programming magnet stationary over “PGM 1” (see Figure 13) for 3 seconds until the display reads “**1-ZERO 2-SPAN**” then withdraw the magnet. Note that the “CAL” LED is on.
- Next, enter the zero menu by holding the magnet stationary over “PGM 1” for 3 seconds until the display reads: “**SETTING ZERO**”, then withdraw the magnet. The sensor has now entered the auto zero mode. When it is complete the display will read “**ZERO COMPLETE**” for 5 seconds and then return to the normal operations menu reading “**(0 PPM)**”.

Zero calibration is complete.

9.2 Calibration Procedure – Span

CAUTION: Verification of the correct calibration gas level setting and calibration span gas concentration is required before “span” calibration. These two numbers must be equal.

Calibration consists of entering the calibration function and following the menu-displayed instructions. The display will ask for the application of span gas in a specific concentration. This concentration must be equal to the calibration gas level setting. The factory default setting for span gas concentration is 50% of range. In this instance, a span gas containing a concentration equal to 50% of range is required. If a span gas containing 50% of range is not available, other concentrations may be used as long as they fall within 10% to 90% of range. However, any alternate span gas concentration value must be programmed via the calibration gas level menu before proceeding with span calibration. Follow the instructions below for span calibration.

- Verify the current calibration gas level setting as indicated by the programming status menu. To do this, follow the instructions in section **Error! Reference source not found.** and make note of the setting found in section 10- **Error! Reference source not found.** The item appears as “**GasLevel @ xxPPM**”.

- b. If the calibration gas level setting is equal to your calibration span gas concentration, proceed to item “f”. If not, adjust the calibration gas level setting so that it is equal to your calibration span gas concentration, as instructed in items “c” through “e”.
- c. Enter the programming menu by holding the programming magnet stationary over “PGM 2” for 30 seconds until the display reads “**VIEW PROG STATUS**” then withdraw the magnet. At this point you can scroll through the programming menu by momentarily waving the programming magnet over “PGM 1” or “PGM 2”. The menu options are: View Program Status, and Set Cal Level.
- d. From the programming menu scroll to the calibration level listing. The menu item appears as: “**SET CAL LEVEL**”. Enter the menu by holding the programming magnet stationary over “PGM 1” for 3 seconds until the display reads “**CalGas @ ##PPM**”, then withdraw the magnet. Use the programming magnet to make an adjustment to “PGM 1” to increase or “PGM 2” to decrease the display reading until the reading is equal to the desired calibration span gas concentration. Exit to the programming menu by holding the programming magnet over “PGM1” for 3 seconds.
- e. Exit back to normal operation by holding the programming magnet over “PGM 2” for 3 seconds, or automatically return to normal operation in 30 seconds.
- f. From the calibration menu “**1-ZERO 2-SPAN**” (section 9.1a) proceed into the span adjust function by holding the programming magnet stationary over “PGM 2” for 3 seconds then withdraw the programming magnet. At this point the display will ask for the application of the target gas and concentration. The display reads “**APPLY xxPPM xxx**” The x’s here will indicate the actual concentration requested.
- g. Apply the calibration test gas at a flow rate of 500 milliliters per minute. As the sensor signal changes, the display will change to “**AutoSpan xxPPM**”. The “xx” part of the reading indicates the actual gas reading which will increase until the sensor stabilizes. When the sensor signal is stable it will auto span to the correct ppm reading and the display will change to “**SPAN COMPLETE**” for 3 seconds, then to “**SENSOR LIFE: xxx%**” and then “**REMOVE GAS**”. Remove the gas. When the signal level has fallen below 10% of full scale, the display will return to the normal operating mode.

NOTE 1: If there is not a minimal response to the cal gas in the first minute, the sensor will enter into the calibration fault mode which will cause the display to alternate between the sensor’s current status reading and the calibration fault screen which appears as: “**SPAN FAULT #1**” (see section 9.3)

NOTE 2: If during the auto-span function the sensor fails to meet a minimum signal stability criteria, the sensor will enter the calibration fault mode which will cause the display to alternate between the sensor’s current status reading and the calibration fault screen which appears as: “**SPAN FAULT #2**” (see section 9.3).

9.3 Additional Notes

1. Upon entering the calibration menu, the 4-20 mA signal drops to 2 mA and is held at this level until you return to normal operation.
2. If during calibration the sensor circuitry is unable to attain the proper adjustment for zero or span, the sensor will enter into the calibration fault mode which will activate the fault LED (see section **Error! Reference source not found.**) and will cause the display to alternate between the sensor’s current status reading and the calibration fault description. In these cases, the previous calibration points will

remain in memory. If this occurs you may attempt to recalibrate by entering the calibration menu as described in section 9.1-a. If the sensor fails again, defer to technical trouble shooting (see section 16.0).

9.4 Calibration Frequency

In most applications, monthly to quarterly calibration intervals will assure reliable detection. However, industrial environments differ. Upon initial installation and commissioning, close frequency tests should be performed, weekly to monthly. Test results should be recorded and reviewed to determine a suitable calibration interval.

10.0 Status of Programming, Version, Alarms, Calibration Level, RS-485, and Sensor Life

The programming menu has a “View Program Status” listing that allows the operator to view the gas, range, and software version number of the program, as well as the calibration gas level setting, and estimated remaining sensor life. The programming menu also allows the changing of the calibration gas level setting (see section 9.2).

The following procedure is used to view the programming status of the sensor:

- 1) First, enter the programming menu by holding the programming magnet stationary over “PGM 2” for 30 seconds until the display reads “**VIEW PROG STATUS**”, then withdraw the magnet. At this point you can scroll through the programming menu by momentarily waving the programming magnet over “PGM 1” or “PGM 2”. The menu options are: View Program Status, Set Alarm 1 Level, Set Alarm 2 Level, and Set Cal Level.
- 2) Next, scroll to the “**VIEW PROG STATUS**” listing and then hold the programming magnet over “PGM 1” for 3 seconds. The menu will then automatically scroll, at five second intervals, through the following information before returning back to the “**VIEW PROG STATUS**” listing.
 - a) The software version number.
 - b) Range is ###.
 - c) The alarm set point level of alarm 1. The menu item appears as: “**ALM1 SET @ ##PPM**”
 - d) The alarm firing direction of alarm 1. The menu item appears as: “**ALM1 ASCENDING**” or descending.
 - e) The alarm relay latch mode of alarm 1. The menu item appears as: “**ALM1 NONLATCHING**” or latching.
 - f) The alarm relay energize state of alarm 1. The menu item appears as: “**ALM1 DE-ENERGIZED**” or energized.
 - g) The alarm set point level of alarm 2. The menu item appears as: “**ALM2 SET @ ##PPM**”
 - h) The alarm firing direction of alarm 2. The menu item appears as: “**ALM2 ASCENDING**” or descending.
 - i) The alarm relay latch mode of alarm 2. The menu item appears as: “**ALM2 LATCHING**” or non- latching.
 - j) The alarm relay energize state of alarm 2. The menu item appears as: “**ALM2 DE-ENERGIZED**” or energized.
 - k) The alarm relay latch mode of the fault alarm. The menu item appears as: “**FLT NONLATCHING**” or latching.
 - l) The alarm relay energize state of the fault alarm. The menu item appears as: “**FLT ENERGIZED**” or de-energized.
 - m) The calibration gas level setting. The menu item appears as: “**CalLevel @ xxPPM**”
 - n) Identification of the RS-485 ID number setting. The menu item appears as: “**485 ID SET @ ##**”
 - o) The estimated remaining sensor life. The menu item appears as: “**SENSOR LIFE 100%**”
- 3) Exit back to normal operations by holding the programming magnet over “PGM 2” for 3 seconds, or automatically return to normal operation in 30 seconds.

11.0 Programming Alarms

11.1 Alarm Levels

Both alarm 1 and alarm 2 levels are factory set prior to shipment. Alarm 1 is set at 20% of range and alarm 2 at 40% of range. Both alarms can be set in 1% increments from 10% to 90% of range. The following procedure is used to change alarm set points:

- a. First, enter the programming menu by holding the programming magnet stationary over “PGM 2” for 30 seconds until the display reads “**VIEW PROG STATUS**”, then withdraw the magnet. At this point you can scroll through the programming menu by momentarily waving the programming magnet over “PGM 1” or “PGM 2”. The menu options are: View Program Status, Set Alarm 1 Level, Set Alarm 2 Level, and Set Cal Level.
- b. ALARM 1 LEVEL From the programming menu scroll to the alarm 1 level listing. The menu item appears as: “**SET ALARM 1 LEVEL**”. Enter the menu by holding the programming magnet stationary over “PGM 1” for 3 seconds until the display reads “**SET ALM1 @ ##PPM**”, then withdraw the magnet. Use the programming magnet to make an adjustment to “PGM 1” to increase or “PGM 2” to decrease the display reading until the reading is equal to the desired alarm set point. Exit to the programming menu by holding the programming magnet over “PGM1” for 3 seconds, or automatically return to the programming menu in 30 seconds.
- c. ALARM 2 LEVEL From the programming menu scroll to the alarm 2 level listing. The menu item appears as: “**SET ALARM 2 LEVEL**”. Enter the menu by holding the programming magnet stationary over “PGM 1” for 3 seconds until the display reads “**SET ALM2 @ ##PPM**”, then withdraw the magnet. Use the programming magnet to make an adjustment to “PGM 1” to increase or “PGM 2” to decrease the display reading until the reading is equal to the desired alarm set point. Exit to the programming menu by holding the programming magnet over “PGM1” for 3 seconds, or automatically return to the programming menu in 30 seconds.
- d. Exit back to normal operations by holding the programming magnet over “PGM 2” for 3 seconds, or automatically return to normal operation in 30 seconds.

11.2 Alarm Reset

An alarm condition will cause the applicable alarm to activate its corresponding relay and LED. If alarm 1, alarm 2, or fault alarms have been programmed for latching relays, an alarm reset function must be activated to reset the alarms after an alarm condition has cleared. To reset the alarms, simply wave the programming magnet over either “PGM 1” or “PGM 2”, momentarily, while in normal operations mode and note that the corresponding alarm LED(s) turn off.

11.3 Other Alarm Functions

Alarms are factory programmed to be non-latching, de-energized; and to fire under ascending gas conditions. The fault alarm relay is programmed as normally energized which is useful for detecting a 24VDC power source failure. All alarm functions are programmable via jumper tabs. Changing alarm functions requires the sensor housing to be opened, thus declassification of the area is required. See section 5.4 for details.

12.0 Program Features

Detcon MicroSafe™ toxic gas sensors incorporate a comprehensive program to accommodate easy operator interface and fail-safe operation. Program features are detailed in this section. Each sensor is factory tested, programmed, and calibrated prior to shipment.

Over Range

When the sensor detects gas greater than 100% of range, it will cause the display to flash the highest reading of its range on and off.

Under Range Fault(s)

If the sensor should drift below a zero baseline of -10% of range, the display will indicate a fault: “**ZERO FAULT**”. This is typically fixed by performing another zero cal. When the total negative zero drift exceeds the acceptable threshold the display will indicate “**SENSOR FAULT**” and you will longer be able to zero calibrate.

Span Fault #1

If during span calibration the sensor circuitry is unable to attain a minimum defined response to span gas, the sensor will enter into the calibration fault mode and cause the display to alternate between the sensor’s current status reading and the calibration fault screen which appears as: “**SPAN FAULT #1**”. The previous calibration settings will remain saved in memory. Previous span calibration is retained.

Span Fault #2

If during the span routine, the sensor circuitry is unable to attain a minimum defined stabilization point, the sensor will enter into the calibration fault mode and cause the display to alternate between the sensor’s current status reading and the calibration fault screen which appears as “**SPAN FAULT #2**”. Previous span calibration is retained.

Memory Fault

If new data points cannot successfully be stored to memory the display will indicate: “**MEMORY FAULT**”.

Fail-Safe/Fault Supervision

Detcon MicroSafe™ sensors are programmed for fail-safe operation. All fault conditions will illuminate the fault LED, and cause the display to read its corresponding fault condition: “**ZERO FAULT**”, “**SENSOR FAULT**”, “**SPAN FAULT #1**”, or “**SPAN FAULT #2**”. A “**SENSOR FAULT**” and “**ZERO FAULT**” will cause the mA output to drop to zero (0) mA.

Sensor Life

The “Sensor Life” feature gauges the remaining sensor life based on signal output from the sensor cell. When sensor life of 25% or less remains the sensor cell should be replaced within a reasonable maintenance schedule.

13.0 Universal Transmitter Feature (Re-Initialization)

The Model DM600IS uses a universal transmitter design that allows the transmitter to be set up for any target gas and any toxic concentration range. The original transmitter set-up is done at Detcon Inc. as part of the sensor test and calibration procedure, but it may also be changed in the field if necessary. The Universal Transmitter feature is a significant convenience to the user because it allows hardware flexibility and minimizes the spare parts requirements to handle unexpected transmitter failures of different gas/ranges. It is however, absolutely critical that changes to gas/range set-up of the Universal Transmitter be consistent with the gas type and range of the Intrinsically Safe Sensor Head that it is connected to.

NOTE: If the Universal Transmitter is changed for gas type and range, it must be consistent with the Intrinsically Safe sensor head it is mated with.

If the Universal Transmitter needs to be changed for gas type and range follow this procedure. First, unplug the transmitter temporarily and then plug it back in. While the message “Universal Transmitter” appears, take the program magnet and swipe it over magnet PGM1. This will reveal the set-up options for gas range and gas type.

Swipe over PGM1 to advance through the options for gas range which include: 1, 2, 3...10 ppm 10, 15, 20...100 ppm

100, 200, 300...1000 ppm

1000, 2000, 3000 10,000 ppm

When the correct range is displayed, hold magnet over PGM1 for 3 seconds to accept the selection.

Next is your selection for the gas type. In this set-up you will enter the alpha-numeric characters of the gas type. Reference the list on page 3 for correct symbols. There is space for the chemical formula up to six characters. Use GM1 and PGM2 swipes to advance through the alphabet and numbers 0-9 selection (there is a blank space after 9). When the correct alphanumeric character is highlighted, hold the magnet over PGM1 for 3 seconds to lock it in. This moves you to the next blank and the procedure is repeated until the chemical formula is completed. After the 6th character is locked in the transmitter will proceed to normal operation.

NOTE 1: If the gas symbol has more than 6 characters, the symbol can be replaced by an abbreviated version of the target gas name such as TOL or TOLUEN for Toluene which has the symbol C₆H₅CH₃. For Epichlorohydrin (symbol C₃H₅OCL) you can substitute the name EPI or EPICHL etc.

NOTE 2: When the Universal Transmitter is re-initialized and a new gas and range is entered, all of the previous customer settings for alarm levels and span gas value are reset to their default levels. These must be re-programmed back to the customer specific settings

14.0 RS-485 Protocol

Detcon MicroSafe™ toxic gas sensors feature Modbus™ compatible communications protocol and are addressable via rotary dip switches for multi-point communications. Other protocols are available. Contact the Detcon factory for specific protocol requirements. Communication is two wire, half duplex 485, 9600 baud, 8 data bits, 1 stop bit, no parity, with the sensor set up as a slave device. A master controller up to 4000 feet away can theoretically poll up to 256 different sensors. This number may not be realistic in harsh environments where noise and/or wiring conditions would make it impractical to place so many devices on the same pair of wires. If a multi-point system is being utilized, each sensor should be set for a different address. Typical address settings are: 01, 02, 03, 04, 05, 06, 07, 08, 09, 0A, 0B, 0C, 0D, 0E, 0F, 10, 11, etc.

In most instances, RS-485 ID numbers are factory set or set during installation before commissioning. If required, the RS-485 ID number can be set via rotary dip switches located on the preamp circuit board. However, any change to the RS-485 ID number would require the sensor housing to be opened, thus declassification of the area would be required. See section 5.4-f) for details on changing the RS-485 ID number.

The following section explains the details of the Modbus™ protocol that the MicroSafe™ sensor supports.

Code 03 - Read Holding Registers is the only code supported by the transmitter. Each transmitter contains 6 holding registers which reflect its current status.

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
0000	Gas type	Sensor Life

Gas type is one of the following:

01=CO, 02=H2S, 03=SO2, 04=H2, 05=HCN, 06=CL2, 07=NO2, 08=NO, 09=HCL, 10=NH3, 11=LEL, 12=O2

Sensor life is an estimated remaining use of the sensor head, between 0% and 100% Example: 85=85% sensor life

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
40001		Detectable Range

i.e. 100 for 0-100 ppm, 50 for 0-50 ppm, etc.

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
40002		Current Gas Reading

The current gas reading as a whole number. If the reading is displayed as 23.5 on the display, this register would contain the number 235.

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
40003		Alarm 1 Set point

This is the trip point for the first alarm.

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
40004		Alarm 2 Set point

This is the trip point for the second alarm.

<u>Register #</u>	<u>High Byte</u>	<u>Low Byte</u>
40005	Status Bits	Status Bits

High Byte

Bit 7	Not used, always 0	
Bit 6	Not used, always 0	
Bit 5	Not used, always 0	
Bit 4	Not used, always 0	
Bit 3	1-Unit is in calibration	0-Normal operation
Bit 2	1-Alarm 2 is ascending	0-Alarm 2 is descending
Bit 1	1-Alarm 2 is normally energized	0-Alarm 2 is normally de-energized
Bit 0	1-Alarm 2 is latching	0-Alarm 2 is non-latching

Low Byte

Bit 7	1-Alarm 2 Relay is energized	0-Alarm 2 Relay is not energized
Bit 6	1-Alarm 1 is ascending	0-Alarm 1 is descending
Bit 5	1-Alarm 1 is normally energized	0-Alarm 1 is normally de-energized
Bit 4	1-Alarm 1 is latching	0-Alarm 1 is non-latching
Bit 3	1-Alarm 1 Relay is energized	0-Alarm 1 Relay is not energized
Bit 2	1-Fault is normally energized	0-Fault is normally de-energized
Bit 1	1-Fault is latching	0-Fault is non-latching
Bit 0	1-Fault Relay is energized	0-Fault Relay is not energized

The following is a typical Master Query for device # 8:

Field Name	HEX	DEC	RTU
Slave Address	08	8	0000 1000
Function	03	3	0000 0011
Start Address Hi	00	0	0000 0000
Start Address Lo	00	0	0000 0000
No. of Registers Hi	00	0	0000 0000
No. of Registers Lo	06	6	0000 0110
CRC	##		#####
CRC	##		#####

The following is a typical Slave Response from device # 8:

Field Name	HEX	DEC	RTU
Slave Address	08	8	0000 1000
Function	03	3	0000 0011
Byte Count	0C	12	0000 1100
Reg40000 Data Hi	02	2	0000 0010
Reg40000 Data Lo	64	100	0110 0100
Reg40001 Data Hi	00	0	0000 0000
Reg40001 Data Lo	64	100	0110 0100
Reg40002 Data Hi	00	0	0000 0000
Reg40002 Data Lo	07	7	0000 0111
Reg40003 Data Hi	00	0	0000 0000
Reg40003 Data Lo	0A	10	0000 1010
Reg40004 Data Hi	00	0	0000 0000
Reg40004 Data Lo	14	20	0001 0100
Reg40005 Data Hi	05	5	0000 0101

Reg40005 Data Lo	50	80	0101 0000
CRC	##		#####
CRC	##		#####

Additional Notes:

The calibration LED will light when the transmitter is sending a response to a Master Query. Communications are 9600 baud, 8 data bits, 1 stop bit, No parity, and half-duplex 485.

On ranges set from 1 ppm to 10 ppm the reading and alarm set points are displayed as ##.##ppm. On ranges set from 15 ppm to 50 ppm the reading and alarm set points are displayed as ##.#ppm.

To accommodate these fractional readings using the Modbus™ interface, the reading and alarm set points are multiplied by 100 before they are stored for retrieval by a Modbus™ command.

Examples:

The transmitter is set for a range of 5 ppm. The display on the transmitter reads 2.74 ppm.

The transmitter is polled for its reading using a Modbus™ command. The value returned in the response is decimal 274.

Obtain the correct reading by dividing. $274/100 = 2.74$ ppm.

The transmitter is set for a range of 25 ppm. The display on the transmitter reads 22.9 ppm.

The transmitter is polled for its reading using a Modbus™ command. The value returned in the response is decimal 2290.

Obtain the correct reading by dividing. $2290/100 = 22.9$ ppm.

On ranges above 50 ppm there is no math involved. The readings are stored the same as they are seen on the transmitters display.

15.0 Display Contrast Adjust

Detcon MicroSafe™ sensors feature a 16 character backlit liquid crystal display. Like most LCDs, character contrast can be affected by viewing angle and temperature. Temperature compensation circuitry included in the MicroSafe™ design will compensate for this characteristic; however temperature extremes may still cause a shift in the contrast. Display contrast can be adjusted by the user if necessary. However, changing the contrast requires that the sensor housing be opened, thus declassification of the area is required.

To adjust the display contrast, remove the enclosure cover and use a jeweler's screwdriver to turn the contrast adjust screw located beneath the metallic face plate. The adjustment location is marked "CONTRAST". See Figure 13 for location.

16.0 Trouble Shooting

Sensor reads Over-range after Power-up

Probable Cause: Biased sensor requiring additional stabilization time.

1. Verify if this is a biased sensor (see section 6.0).
2. Wait up to 8 hours for unit to come on-scale if using a low range biased sensor.
3. Verify that there are not large amounts of target gas or interfering gases in background.

Reading Higher than Anticipated

Probable Causes: Target or Interfering gases in background, Incorrect calibration for Zero or Span, Biased sensor still stabilizing.

1. Verify no target or interfering gases are present.
2. Redo Zero and Span calibrations with validated Zero Gas and Span Gas standards.
3. If recovering after a start-up, give more time to stabilize.

Reading Lower than Anticipated

Probable Causes: Target gas or Interfering gases in background during Zero Calibration, Zero Calibration done before unit finished stabilizing, or Incorrect Span Calibration.

1. Redo Zero and Span calibrations with validated Zero Gas and Span Gas standards.

Sensor Fault

Probable Causes: Yellow wire is connected. Sensor has drifted since last zero cal.

1. Remove yellow wire if connected.
2. Redo Zero calibration

Zero Calibration Fault

Probable Causes: Target gas or Interfering gases in background during Zero Calibration, Failed electrochemical sensor.

1. Verify no target or interfering gases are present.
2. Redo Zero and Span calibrations with validated Zero Gas and Span Gas standards.
3. If recovering after a start-up, give more time to stabilize.

Span Calibration Fault

Probable Causes: Failed electrochemical sensor, ice/mud/dust blocking sensor membrane, invalid span calibration gas do to age and contamination or insufficient flow rate.

1. Verify there is no ice/mud/dust blocking sensor membrane.
2. Redo Span Calibration with validated Span Gas standard (check with Pull Tube).
3. Reinitialize unit by plugging in transmitter while holding the magnet on PGM1. Scroll through and select the correct gas type. Make sure all customer settings are re-entered after “re-initialization”.
4. Replace with new electrochemical sensor.

Noisy Sensor (continuous drift) or suddenly Spiking

Probable Cause: Unstable power source, inadequate grounding, Inadequate RFI protection.

1. Verify power Source output and stability.
2. Contact Detcon for assistance in optimizing shielding and grounding.
3. Add RFI Protection accessory available from Detcon.

LCD Difficult to Read

Probable Cause: Needs adjustment.

1. Adjust contrast pot as necessary.

Reporting “ERROR @ XXXXXXXX”

Probable Cause: Span calibration calculation error.

1. Reinitialize unit by plugging in transmitter and the swiping the magnet over PGM1 while “Universal Transmitter” is displayed. Scroll through and select the correct gas type and range (see section **Error! Reference source not found.**). Make sure all customer specific settings are re-entered after “re-initialization”.

17.0 Spare Parts List

943-000006-132	Calibration Adapter
500-001794-004	Connector board
327-000000-000	Programming Magnet
897-850901-010	Aluminum Condulet Assembly
897-850901-315	Stainless Steel Condulet Assembly
960-202200-000	Condensation prevention packet (replace annually).
926-995580-000	DM-6xx Series Universal Plug-in Control Circuit
925-845580-04P*	DM-6xx-H2 LEL range Series Universal Plug-in Control Circuit

* The H2 LEL range transmitter is not universal but is discrete to Hydrogen in the 0-4% by volume range.

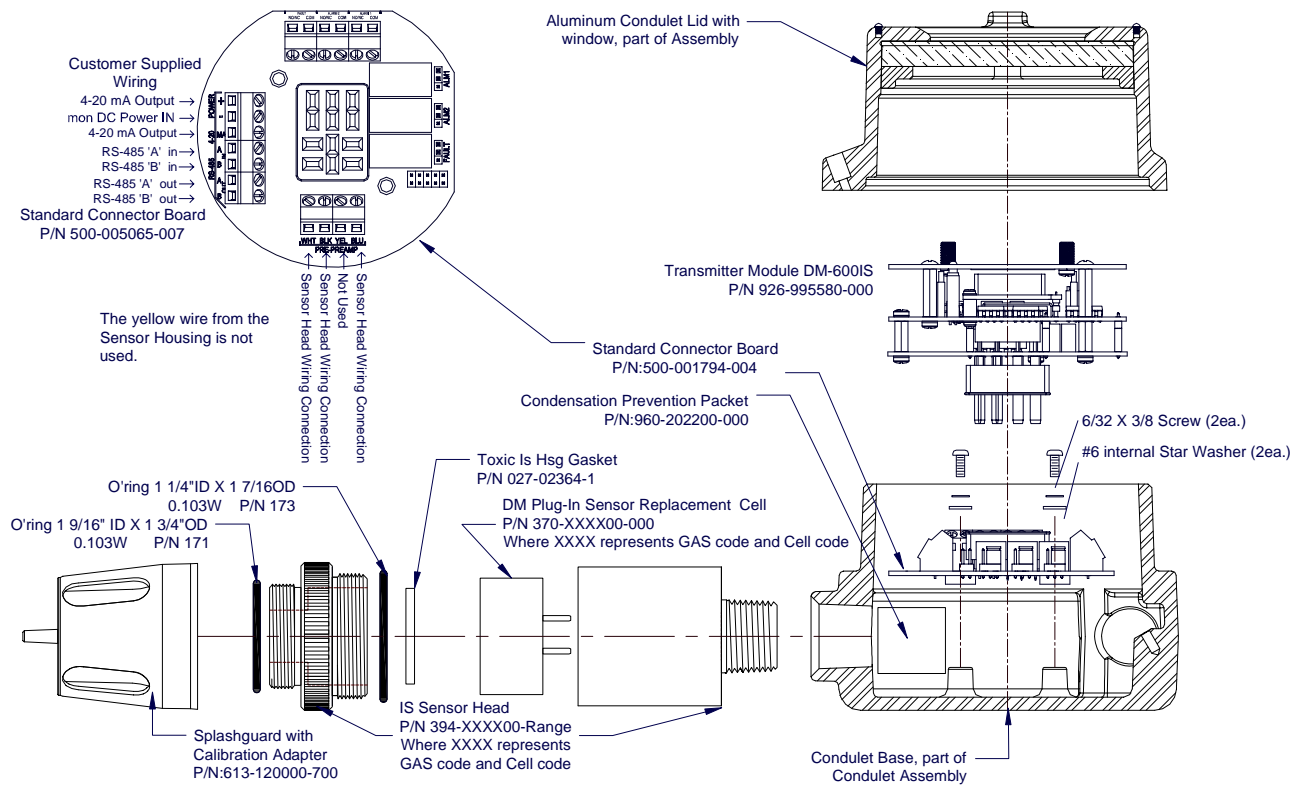


Figure 15 Spare parts diagram

Table 6 IS Sensor Head / Plug-in Replacement Sensor Cell

Model Number	GasName	IS Sensor Head	Plug-in Replacement Sensor Cell
DM-600IS-C2H3O	Acetaldehyde	394-12EA00-Range	370-12EA00-000
DM-600IS-C2H2	Acetylene	394-12EG00-Range	370-12EG00-000
DM-600IS-C3H3N	Acrylonitrile	394-12EM00-Range	370-12EM00-000
DM-600IS-NH3 (-20°C)	Ammonia	394-171700-Range	370-171700-000
DM-601IS-NH3 (-40°C)	Ammonia	394-151500-Range	370-151500-000
DM-602IS-NH3 (CE)	Ammonia	394-505000-Range	370-505000-000
DM-600IS-AsH3	Arsine	394-191900-Range	370-191900-000
DM-600IS-Br2	Bromine	394-747500-Range	370-747500-000
DM-600IS-C4H6	Butadiene	394-12EB00-Range	370-12EB00-000
DM-600IS-CS2	Carbon Disulfide	394-12EH00-Range	370-12EH00-000
DM-600IS-CO	Carbon Monoxide	394-444400-Range	370-444400-000
DM-600IS-COS	Carbonyl Sulfide	394-12EN00-Range	370-12EN00-000
DM-600IS-CL2	Chlorine	394-747400-Range	370-747400-000
DM-600IS-CLO2 (>10ppm)	Chlorine Dioxide	394-747600-Range	370-747600-000
DM-601IS-CLO2 (≤10ppm)	Chlorine Dioxide	394-777700-Range	370-777700-000
DM-600IS-B2H6	Diborane	394-192100-Range	370-192100-000
DM-600IS-C2H6S	Dimethyl Sulfide	394-12EC00-Range	370-12EC00-000
DM-600IS-C3H5OCL	Epichlorohydrin	394-12EI00-Range	370-12EI00-000
DM-600IS-C2H5OH	Ethanol	394-12EO00-Range	370-12EO00-000
DM-600IS-C2H5SH	Ethyl Mercaptan	394-24EZ00-Range	370-24EZ00-000
DM-600IS-C2H4	Ethylene	394-12ED00-Range	370-12ED00-000
DM-600IS-C2H4O	Ethylene Oxide	394-12EJ00-Range	370-12EJ00-000
DM-600IS-F2	Fluorine	394-272700-Range	370-272700-000
DM-600IS-CH2O	Formaldehyde	394-12EP00-Range	370-12EP00-000
DM-600IS-GeH4	Germane	394-232500-Range	370-232500-000
DM-600IS-N2H4	Hydrazine	394-262600-Range	370-262600-000
DM-600IS-H2 (ppm)	Hydrogen	394-848400-Range	370-848400-000
DM-601IS-H2 (LEL)	Hydrogen	394-050500-Range	370-050500-000
DM-600IS-HBr	Hydrogen Bromide	394-090800-Range	370-090800-000
DM-600IS-HCL	Hydrogen Chloride	394-090900-Range	370-090900-000
DM-600IS-HCN	Hydrogen Cyanide	394-131300-Range	370-131300-000
DM-600IS-HF	Hydrogen Fluoride	394-333300-Range	370-333300-000
DM-600IS-H2S	Hydrogen Sulfide	394-242400-Range	370-242400-000
DM-600IS-CH3OH	Methanol	394-12EE00-Range	370-12EE00-000
DM-600IS-CH3SH	Methyl Mercaptan	394-24EK00-Range	370-24EK00-000
DM-600IS-NO	Nitric Oxide	394-949400-Range	370-949400-000
DM-600IS-NO2	Nitrogen Dioxide	394-646400-Range	370-646400-000
DM-600IS-O3	Ozone	394-393900-Range	370-393900-000
DM-600IS-COCL2	Phosgene	394-414100-Range	370-414100-000
DM-600IS-PH3	Phosphine	394-192000-Range	370-192000-000
DM-600IS-SiH4	Silane	394-232300-Range	370-232300-000
DM-600IS-SO2	Sulfur Dioxide	394-555500-Range	370-555500-000
DM-600IS-C4H8S	Tetrahydrothiophene	394-434300-Range	370-434300-000
DM-600IS-C4H4S	Thiophane	394-12EQ00-Range	370-12EQ00-000
DM-600IS-C6H5CH3	Toluene	394-12ER00-Range	370-12ER00-000
DM-600IS-C4H6O2	Vinyl Acetate	394-12EF00-Range	370-12EF00-000
DM-600IS-C2H3CL	Vinyl Chloride	394-12EL00-Range	370-12EL00-000

18.0 Warranty

Detcon, Inc., as manufacturer, warrants each new electrochemical toxic gas plug-in sensor cell, for a specified period under the conditions described as follows: The warranty period begins on the date of shipment to the original purchaser and ends after the specified period as listed in the table in Section 4.0. The sensor cell is warranted to be free from defects in material and workmanship. Should any sensor cell fail to perform in accordance with published specifications within the warranty period, return the defective part to Detcon, Inc., 4055 Technology Forest Blvd. Suite 100, The Woodlands, Texas 77381, for necessary repairs or replacement.

19.0 Service Policy

Detcon, Inc., as manufacturer, warrants under intended normal use each new DM-600IS series plug-in signal transmitter Control Circuit and intrinsically safe Sensor Head circuit to be free from defects in material and workmanship for a period of two years from the date of shipment to the original purchaser. Detcon, Inc., further provides for a five year fixed fee service policy wherein any failed signal Transmitter shall be repaired or replaced as is deemed necessary by Detcon, Inc., for a fixed fee of \$65.00. Any failed intrinsically safe Sensor Head circuit shall be repaired or replaced as is deemed necessary by Detcon, Inc., for a fixed fee of \$55.00. The fixed fee service policy shall affect any factory repair for the period following the two year warranty and shall end five years after expiration of the warranty. All warranties and service policies are FOB the Detcon facility located in The Woodlands, Texas.

20.0 Revision History

Revision	Date	Changes made	Approval
1.5.6	09/12/06	Previous release.	BM
1.5.7	11/19/10	Calibration adapter changed from 943-000217-5A1 to 943-000006-132	BM
1.5.8	11/08/10	Correction of wrong value in Cross Interference table. Value for CO interfering with C ₂ H ₃ CL was 12150=100, changed to 200=100	BM
1.5.9	01/10/13	Converted manual from Quark to MS Word. Added statement about maximum distance of sensor separation (Section 5.5)	BM
1.6.0	08/06/15	Correct wiring of Sensor and Remote Sensor	LU
1.6.1	08/17/15	Correct wiring of Sensor, update Spare Parts	LU

Shipping Address 4055 Technology Forest Blvd. Suite 100,., The Woodlands Texas 77381

Mailing Address: P.O. Box 8067, The Woodlands Texas 77387-8067

Phone: 888.367.4286, 281.367.4100 • Fax: 281.292.2860 • www.detcon.com • sales@detcon.com